

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.



LO-2, LO-4, Dual LO-4, & LO-6 High Energy Ignition Systems Installation and Operation Manual



PN: 07070204-xxx

PN: 07070404-xxx

PN: 07070604-xxx



PN: 07070214-xxx

PN: 07070414-xxx


PN: 07070614-xxx



PN: 07670204-xxx

PN: 07670404-xxx

PN: 07670604-xxx

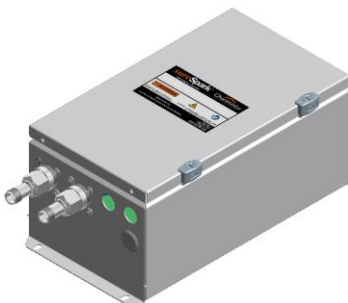

PN: 07072404-GXI

**KEEP THIS MANUAL IN A SAFE PLACE
FOR FUTURE REFERENCE**

**READ THIS MANUAL BEFORE USING THIS PRODUCT. FAILURE TO FOLLOW THE INSTRUCTIONS AND SAFETY
PRECAUTIONS IN THIS MANUAL CAN RESULT IN SEVERE INJURY, DEATH, OR DAMAGE TO EQUIPMENT.**

FOR A LIST OF RELEVANT PATENTS AND TRADEMARKS, PLEASE SEE CHENTRONICS.COM/LEGAL-NOTICES

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

SURESPARK LO MANUAL

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

PAGE 1 OF 28

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

Contents

1.0 Important Safety Information.....	3
2.0 Definition	5
3.0 System Specifications	5
3.1 Description of Equipment	5
3.2 General Arrangements.....	6
3.3 Enclosure Configurations:	9
3.4 Description of Equipment	10
3.5 Equipment Conditions of Use	10
3.6 System Electrical and Physical Specifications.....	11
4.0 Installation Instructions.....	14
4.1 Instructions for Lifting.....	14
4.2 Mounting	14
4.3 2-Wire Harness and Base Rod Installation	15
4.4 ½in NPT Male Harness and Base Rod Installation	15
4.5 02 Series Igniter and Extension Rod Installation	16
4.6 Coaxial Output Harness and Igniter Installation	17
4.7 Safety wire Installation (Optional)	18
4.8 Wiring Installation.....	19
4.9 Installing the Igniter into a Burner	21
4.10 Equipment Earth Bond	21
5.0 System Operational Inputs and Outputs.....	23
5.1 Terminal Key	23
5.2 Electrical Area Classification and Safety Markings	24
5.3 System Schematic Diagram.....	25
5.4 Firing the Igniter.....	26
5.5 Spark Indicator	26
5.6 Igniter Wear Detection	26
6.0 Maintenance	27
6.1 Service.....	27
6.2 Cleaning	27
7.0 Standard Components and Accessories	28
7.1 Standard 2-Wire Output System Components.....	28
7.2 Standard ARP 670 Coaxial System Components	28
7.3 Standard Explosion Proof Enclosure System Components	28
8.0 Warranty Instructions.....	28
9.0 Technical Support	28

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

SURESPARK LO MANUAL

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

PAGE 2 OF 28

Chentronics®

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

1.0 Important Safety Information



Read All Instructions Before Using the Equipment



The instructions in this manual serve as a general guide. It is intended for use by qualified personnel with knowledge of equipment of this type. It is not intended to cover all possible variations in equipment or to provide for specific operating problems which may arise.

You are responsible for adhering to all warnings or cautions provided in this manual.

In addition to any general safety measures provided in this manual, you must comply with all national, state, local, and company safety regulations.

Safety Symbols used in this manual comply with ISO 3864.

THESE SYMBOLS INDICATE POTENTIAL PERSONAL INJURY HAZARDS.

OBEY ALL SAFETY MESSAGES THAT FOLLOW THESE SYMBOLS TO AVOID POSSIBLE INJURY OR DEATH.



Indicates a hazard with a high level of risk, which, if not avoided, will result in death or severe injury.



Indicates a hazard with a medium level of risk, which, if not avoided, could result in death or severe injury.



Indicates a hazard with a low level of risk, which, if not avoided, will result in minor or moderate injury.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

SURESPARK LO MANUAL

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

PAGE 3 OF 28

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)

< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)

± 0.010 DECIMAL DIM (2 PLACES)

± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.



⚠ DANGER **HAZARDOUS VOLTAGE**



The equipment contains a High Energy Ignition System, which contains **DANGEROUS AND POTENTIALLY LETHAL VOLTAGE**. To avoid the risk of serious injury from electric shock, always follow the safety precautions listed below:

Disconnect power before servicing the equipment.

Ensure the equipment is appropriately bonded to earth before use. See Section 4.10 regarding equipment earth bond locations.

Do not join or separate any connection to the equipment when the equipment is energized.

Do not apply power to the equipment without an igniter.

Keep the igniter firing end away from all personnel and flammable material.

The equipment must be installed and serviced by qualified personnel per this manual and applicable local and national codes, standards, and ordinances.

The equipment is not field-repairable. Do not attempt to disassemble or repair the equipment.

Les symboles de sécurité utilisés dans ce manuel sont conformes à la norme ISO 3864.

CES SYMBOLES SONT UTILISÉS POUR VOUS AVERTIR DES RISQUES DE BLESSURES POTENTIELS.

RESPECTEZ TOUS LES MESSAGES DE SÉCURITÉ QUI SUIVENT CES SYMBOLES POUR ÉVITER LES BLESSURES POTENTIELLES OU LA MORT.



Indique un danger avec un niveau élevé de risque qui, s'il n'est pas évité, entraînera la mort ou des blessures graves.



Indique un danger avec un niveau de risque moyen qui, s'il n'est pas évité, pourrait entraîner la mort ou des blessures graves.



Indique un danger avec un niveau de risque bas qui, s'il n'est pas évité, entraînera des blessures mineures ou modérées.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

SURESPARK LO MANUAL

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

PAGE 4 OF 28

Chentronics

SURESPARK LO MANUAL



DANGER
TENSION DANGEREUSE



L'appareil contient un système d'allumage à haute énergie qui contient une **TENSION DANGEREUSE ET POTENTIELLEMENT MORTELLE**. Pour éviter les risques de blessures graves par électrocution, suivez toujours les précautions de sécurité indiquées ci-dessous:

Coupez l'alimentation avant l'entretien du matériel.

S'assurer que l'équipement est correctement mis à la terre avant l'utilisation. Voir la section 4.10 concernant l'emplacement des liaisons à la terre de l'équipement.

Ne pas connecter ou séparer toute connexion à l'équipement lorsque l'appareil est sous tension.

Ne pas appliquer de tension à l'appareil sans un allumeur.

Gardez l'extrémité de l'allumeur loin de tout personnel et de matériels inflammables.

L'équipement doit être installé et entretenu par du personnel qualifié, conformément à ce manuel, aux codes locaux et nationaux applicables, et aux normes et règlements en vigueur.

L'appareil n'est pas réparable sur site. Ne tentez pas de démonter ou de réparer l'équipement.

2.0 Definition

Spark: An electric current arc.

High Energy Ignition: Electric spark ignition system utilizing high energy sparks for direct ignition of hydrocarbon fuels such as gas, diesel, or #6 oil.

High Energy Exciter: An electronic device that stores electric charge and releases it cyclically in abrupt bursts to an igniter to create high-power sparks.

3.0 System Specifications

3.1 Description of Equipment

The Chentronics® SureSpark™ High Energy Exciter LO-2, LO-4, and LO-6 series high energy ignition systems are specifically designed to ignite gas, light oil (#2), and diesel fuels directly while operating in a wide range of environmental conditions. For convenience, there is an external Spark LED (two for dual units, one per output) which indicates when the igniter is sparking and when the igniter tip needs to be replaced. This allows the user to replace igniter tips before they fail and prevent ignition faults from occurring. The Igniter Wear indicator also turns red when an igniter fault is detected and remains on until the run signal is cycled. This additional feature allows for easier location of failed units when multiple units are being operated simultaneously.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

SURESPARK LO MANUAL

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

PAGE 5 OF 28

Chentronics®

TOLERANCE NOTES
FABRICATED TOLERANCES
≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

3.2 General Arrangements

Coaxial Output LO Series Exciter

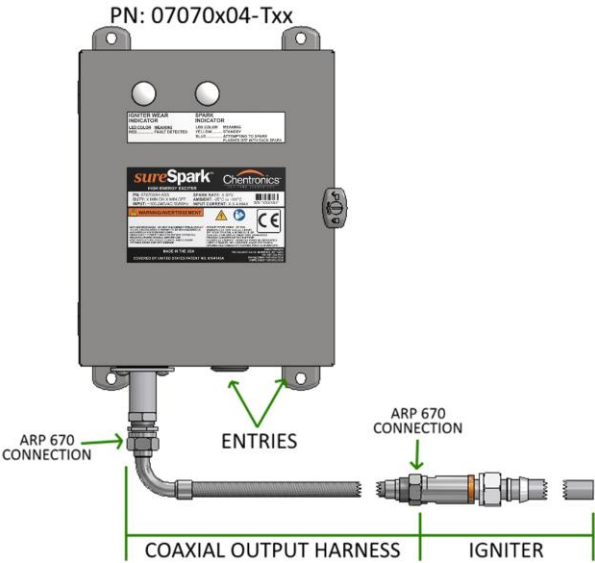


Figure 2: Ordinary area, Coaxial LO series ignition system general arrangement.

NOTE: Harness and igniter are sold separately.

2-Wire LO Series Exciter

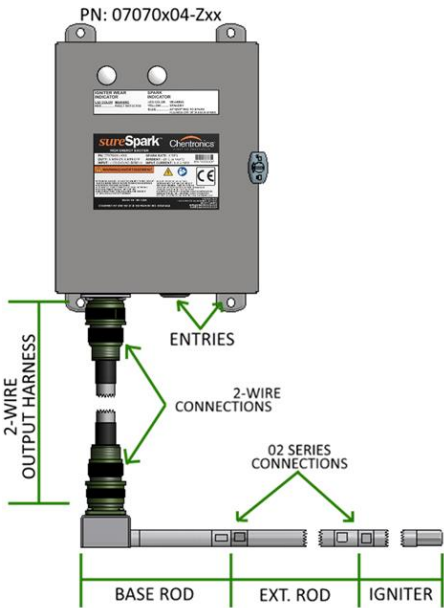


Figure 3: Ordinary area, 2-Wire LO series ignition system general arrangement.

NOTE: Harness, base rod, extension rod (optional), and igniter are sold separately.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

SURESPARK LO MANUAL

PAGE 6 OF 28

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

Chentronics

<div><div>TOLERANCE NOTES</div><div>FABRICATED TOLERANCES</div><div>≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)</div><div>< 2ft (610 mm) ± 0.125 in (3.2 mm)</div><div>MACHINED TOLERANCES</div><div>± 0.050 DECIMAL DIM (1 PLACE)</div><div>± 0.010 DECIMAL DIM (2 PLACES)</div><div>± 0.005 DECIMAL DIM (3 PLACES)</div></div>	<div>SURESPARK LO MANUAL</div>	<div>THIS DRAWING OWNED BY CHENTRONICS. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO CHENTRONICS. FOR MORE INFORMATION PLEASE CONTACT CHENTRONICS AT +1.607.334.5531.</div>
<div><div>LO Series Exciter with Explosion Proof Enclosure</div><div><div><div>PN: 07670x04-xxx</div><div><div><div><div></div></div><div><div>ENTRIES</div></div><div><div>1/2in NPT CABLE GLANDS</div></div><div><div>CABLE OUTPUT HARNESS</div></div><div><div>BASE ROD</div></div><div><div>02 SERIES CONNECTIONS</div></div><div><div>EXT. ROD</div></div><div><div>IGNITER</div></div></div></div></div></div><div><div>Figure 4: LO series ignition system with explosion-proof enclosure general arrangement.</div><div>NOTE: Harness, base rod, extension rod (optional), and igniter are sold separately.</div></div></div>		
<div><div>Coaxial Dual Output LO-4 Exciter</div><div><div><div><div>PN: 07072404-Gxx</div><div><div><div><div></div></div><div><div>ENTRIES</div></div><div><div>ARP TYPE 5F CONNECTIONS</div></div><div><div>ARP 670 OUTPUT HARNESS</div></div><div><div>IGNITER</div></div></div></div></div></div><div><div>Figure 5: SureSpark™ High Energy Exciter Coaxial Dual Output ignition system general arrangement (ARP 670 Type 5F connections).</div><div>NOTE: Harnesses and igniters are sold separately.</div></div></div></div>		
<div><div>RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):</div><div>CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180</div></div>		
<div><div>FOR A LIST OF RELEVANT PATENTS AND TRADEMARKS PLEASE SEE CHENTRONICS.COM/LEGAL-NOTICES</div><div>ISO 9001 CERTIFIED</div><div><div>DRAWN BY:</div><div>AR</div></div><div><div>ON:</div><div>2022-MAR-04</div></div><div><div>LAST REV BY:</div><div>xyz</div></div><div><div>ON:</div><div>x/y/z</div></div></div>	<div><div>SURESPARK LO MANUAL</div><div><div>DCO No. 14804</div><div>DWG. No. MNL-SURESPARK LO</div><div>REV. F</div></div></div>	<div><div>PAGE 7 OF 28</div><div><div>Chentronics</div></div></div>

2-Wire Dual Output LO-4 Exciter

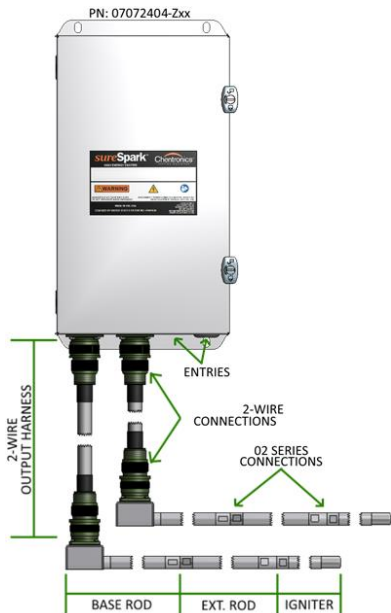


Figure 6: SureSpark™ High Energy Exciter 2-Wire Dual Output ignition system general arrangement.
NOTE: Harnesses, base rods, extension rods (optional), and igniters are sold separately.

Coaxial Dual Output LOTS system

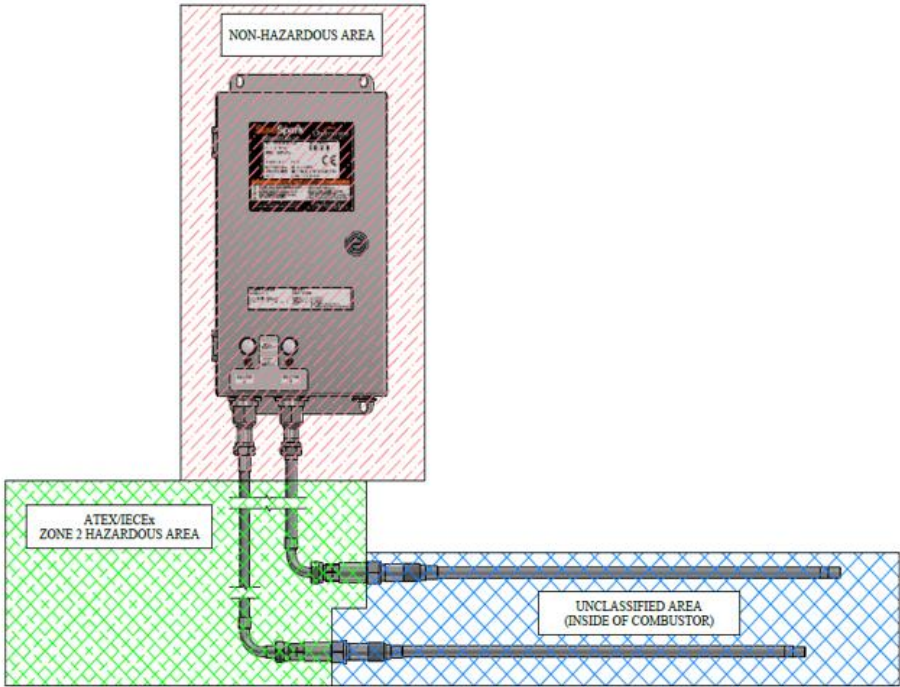


Figure 7: SureSpark™ High Energy Exciter LOTS system general arrangement.
NOTE: Harnesses and igniters are sold separately.

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)

< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)

± 0.010 DECIMAL DIM (2 PLACES)

± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

3.3 Enclosure Configurations:

The SureSpark™ High Energy Exciter LO-2, LO-4, and LO-6 systems are available in the enclosure configurations as described below:

- **07070x04-xxx** – Plate-metal enclosure with painted mild steel, 304 stainless steel, or 316 stainless steel options. Available with optional spark switch.



- **07070x14-xxx** – Fiberglass enclosure with optional spark switch.



- **07670x04-xxx** – Explosion-proof enclosure with optional spark switch.



RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

SURESPARK LO MANUAL

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

PAGE 9 OF 28

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)


MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY CHENTRONICS. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO CHENTRONICS. FOR MORE INFORMATION PLEASE CONTACT CHENTRONICS AT +1.607.334.5531.

- **07072404-xxx** – Dual-Output, Plate-metal enclosure with painted mild steel, 304 stainless steel, or 316 stainless steel options. Available with optional spark switch.

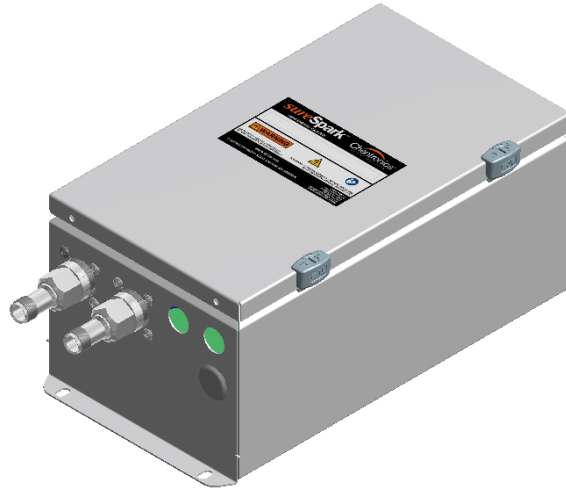

3.4 Description of Equipment

The equipment is sealed in an enclosure that has an IP66 rating. The 304/316 stainless steel or fiberglass enclosure options provide NEMA Type 4X rating.

3.5 Equipment Conditions of Use

The SureSpark™ High Energy Exciter system equipment is subject to the following conditions of use and limitations:

1. All wiring must be rated at or above 90°C. The installation must use a conduit or an entry hub to protect the wiring from damage.
2. A switch or circuit breaker to separate the device from the mains must be included in the installation. The switch or circuit breaker must be suitably located and easily reached. It is recommended that it be located near the exciter enclosure.
3. The lid shall not be unlocked or opened until the power has been turned off for at least 5 minutes.
4. The equipment shall not be subjected to ambient temperatures greater than +75°C or less than -25°C while operating. For the LO-2 series, +60°C shall not be exceeded.
5. The equipment's igniter connections shall not be joined or separated when the equipment is in use (powered).
6. The equipment shall not be operated without an igniter attached.
7. Equipment shall be adequately grounded. Please see Section 4.10 regarding earth bond requirements in this manual.
8. The igniter, extension rod, or base rod must be secured to the grounded building frame using a metal fixture.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY: AR
ON: 2022-MAR-04

LAST REV BY: xyz
ON: x/y/z

SURESPARK LO MANUAL

PAGE 10 OF 28

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

Chentronics®

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

3.6 System Electrical and Physical Specifications

LO-2 Specifications:

Application:	High-energy, direct-spark ignition system
Input Power:	100-240VAC 50/60Hz, 0.5A MAX
Exciter Type:	High Energy Ignition
Exciter Duty Cycle:	100% Continuous
Exciter Spark Command:	With the jumper, apply power to begin sparking. Without the jumper, apply 24V DC, close contacts, or push-button switch (optional) to begin sparking.
Exciter Spark Indicator:	When powered and on standby, LED is solid Yellow . When attempting to spark, LED turns Blue and flashes off steadily when successful spark output currents are detected.
Igniter Wear Indicator:	When an igniter fault is detected, LED turns on solid Red and remains on until the spark signal is removed and re-applied.
Exciter Energy:	12J min per Spark
Exciter Spark Rate:	2 SPS min
Operating Temperature Limits:	-25°C to 60°C
Storage Temperature Limits:	-40°C to 105°C
Humidity:	0 to 100% condensing
Enclosure:	
07070204:	Brushed Stainless Steel (304 or 316) or Gray Painted Mild Steel
07070214:	Fiberglass
07670204:	Copper Free Cast Aluminum
Weight:	
07070204:	Approximately 15lb (7 kg)
07070214:	Approximately 11lb (5 kg)
07670204:	Approximately 35lb (16 kg)
Dimensions:	
07070204:	8.4 x 6.6 x 10 in
07070214:	7.6 x 6.2 x 9.6 in
07670204:	11.6 x 8.0 x 10.5 in

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY: AR
ON: 2022-MAR-04

LAST REV BY: xyz
ON: x/y/z

SURESPARK LO MANUAL

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

PAGE 11 OF 28

Chentronics®

TOLERANCE NOTES
FABRICATED TOLERANCES
≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

LO-4 Specifications:

Application:	High-energy, direct-spark ignition system
Input Power:	100-240VAC 50/60Hz, 1A MAX
Exciter Type:	High Energy Ignition
Exciter Duty Cycle:	5 min on, 10 min off
Exciter Spark Command:	With the jumper, apply power to begin sparking. Without jumper, apply 24V DC, close contacts, or push-button switch (optional) to spark.
Exciter Spark Indicator:	When powered and on standby, LED is solid Yellow . When attempting to spark, LED turns Blue and flashes off steadily when successful spark output currents are detected.
Igniter Wear Indicator:	When an igniter fault is detected, LED turns on solid Red and remains on until the spark signal is removed and re-applied.
Exciter Energy:	12J min per Spark
Exciter Spark Rate:	4 SPS min
Operating Temperature Limits:	-25°C to 75°C
Storage Temperature Limits:	-40°C to 105°C
Humidity:	0 to 100% condensing
Enclosure:	
07070404:	Brushed Stainless Steel (304 or 316) or Gray Painted Mild Steel
07070414:	Fiberglass
07670404:	Copper Free Cast Aluminum
Weight:	
07070404:	Approximately 15lb (7 kg)
07070414:	Approximately 11lb (5 kg)
07670404:	Approximately 35lb (16 kg)
Dimensions:	
07070404:	8.4 x 6.6 x 10 in
07070414:	7.6 x 6.2 x 9.6 in
07670404:	11.6 x 8.0 x 10.5 in

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY: AR
ON: 2022-MAR-04

LAST REV BY: xyz
ON: x/y/z

SURESPARK LO MANUAL

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

PAGE 12 OF 28

Chentronics®

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

LO-6 Specifications:

Application:	High-energy, direct-spark ignition system
Input Power:	100-240VAC 50/60Hz, 1.5A MAX
Exciter Type:	High Energy Ignition
Exciter Duty Cycle:	5 min on, 10 min off
Exciter Spark Command:	With the jumper, apply power to begin sparking. Without jumper, apply 24V DC, close contacts, or push-button switch (optional) to spark.
Exciter Spark Indicator:	When powered and on standby, LED is solid Yellow . When attempting to spark, LED turns Blue and flashes off steadily when successful spark output currents are detected.
Igniter Wear Indicator:	When an igniter fault is detected, LED turns on solid Red and remains on until the spark signal is removed and re-applied.
Exciter Energy:	12J min per Spark
Exciter Spark Rate:	6 SPS min
Operating Temperature Limits:	-25°C to 75°C
Storage Temperature Limits:	-40°C to 105°C
Humidity:	0 to 100% condensing
Enclosure:	
07070604:	Brushed Stainless Steel (304 or 316) or Gray Painted Mild Steel
07070614:	Fiberglass
07670604:	Copper Free Cast Aluminum
Weight:	
07070604:	Approximately 15lb (7 kg)
07070614:	Approximately 11lb (5 kg)
07670604:	Approximately 35lb (16 kg)
Dimensions:	
07070604:	8.4 x 6.6 x 10 in
07070614:	7.6 x 6.2 x 9.6 in
07670604:	11.6 x 8.0 x 10.5 in

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY: AR
ON: 2022-MAR-04

LAST REV BY: xyz
ON: x/y/z

SURESPARK LO MANUAL

PAGE 13 OF 28

Chentronics®

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

TOLERANCE NOTES
FABRICATED TOLERANCES
≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY CHENTRONICS. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO CHENTRONICS. FOR MORE INFORMATION PLEASE CONTACT CHENTRONICS AT +1.607.334.5531.

Dual Output LO-4 Specifications:

Application:	High-energy, direct-spark ignition system
Input Power:	100-240VAC 50/60Hz, 2A MAX
Exciter Type:	High Energy Ignition
Exciter Duty Cycle:	5 min on, 10 min off
Exciter Spark Command:	With the jumper, apply power to begin sparking. Without jumper, apply 24V DC, close contacts, or push-button switch (optional) to spark.
Exciter Spark Indicator:	When powered and on standby, LED is solid Yellow . When attempting to spark, LED turns Blue and flashes off steadily when successful spark output currents are detected.
Igniter Wear Indicator:	When an igniter fault is detected, LED turns on solid Red and remains on until the spark signal is removed and re-applied.
Exciter Energy:	2x 12J min per Spark
Exciter Spark Rate:	2x 4 SPS min
Operating Temperature Limits:	-25°C to 75°C
Storage Temperature Limits:	-40°C to 105°C
Humidity:	0 to 100% condensing
Enclosure:	Brushed Stainless Steel (304 or 316) or Gray Painted Mild Steel
Weight:	Approximately 30lb (14 kg)
Dimensions:	10.0 x 7.0 x 17.3 in

4.0 Installation Instructions

4.1 Instructions for Lifting

The exciter should be carried only by someone capable of safely lifting 35lb.

4.2 Mounting

For mounting dimensions, refer to the equipment data sheet. The exciter should be mounted to a firm structure. The exciter output is characterized as a high current transient pulse. Typical discharge currents are exponential decay with peaks of approximately 1000 amps that last less than 1ms. Although the coaxial construction and outer shielding suppress much of the electromagnetic field, separating ignition cables from signal cables is good practice to prevent noise coupling. However, the ignition circuit is unaffected by other (nearby) ignition sources, and multiple output cables can share the same tray.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

SURESPARK LO MANUAL

PAGE 14 OF 28

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

Chentronics®

TOLERANCE NOTES
FABRICATED TOLERANCES
≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY CHENTRONICS. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO CHENTRONICS. FOR MORE INFORMATION PLEASE CONTACT CHENTRONICS AT +1.607.334.5531.

4.3 2-Wire Harness and Base Rod Installation

Insert the male end of the harness into the connector on the exciter and fully hand-tighten it. Next, connect the female end of the harness to the base rod and fully hand-tighten it.

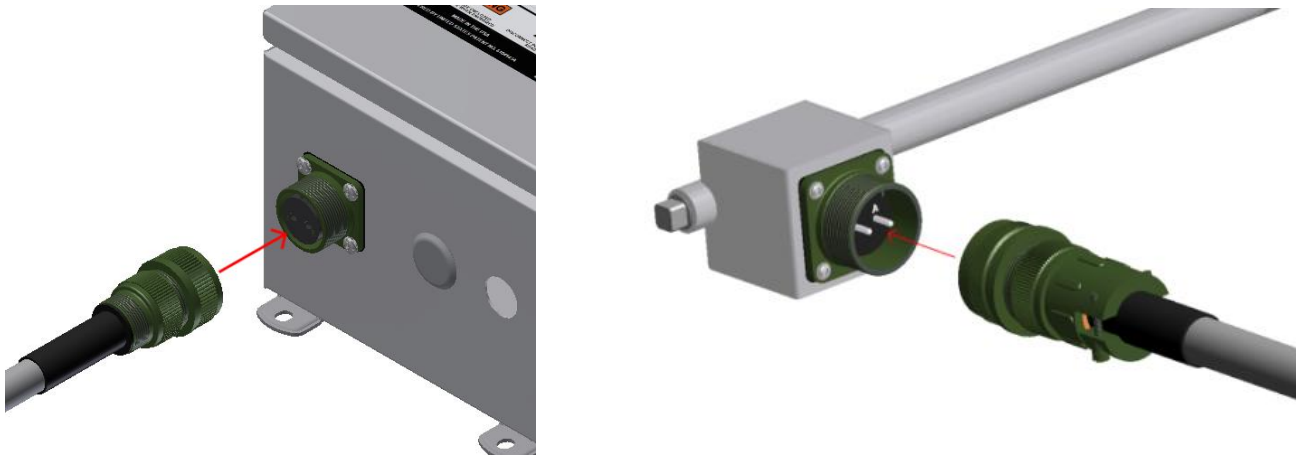


Figure 8: Output Harness and Base Rod installation for units with 2-wire connectors.

4.4 1/2in NPT Male Harness and Base Rod Installation

Install one end of the harness to the exciter enclosure by following the manufacturer's instructions for cable-gland installation. Next, connect the **black** harness wire to the terminal marked "LO" and connect the remaining harness wire (**red** or **white**) to the terminal marked "HI" on the exciter top board. A correct connection is shown in Figure 9 below.

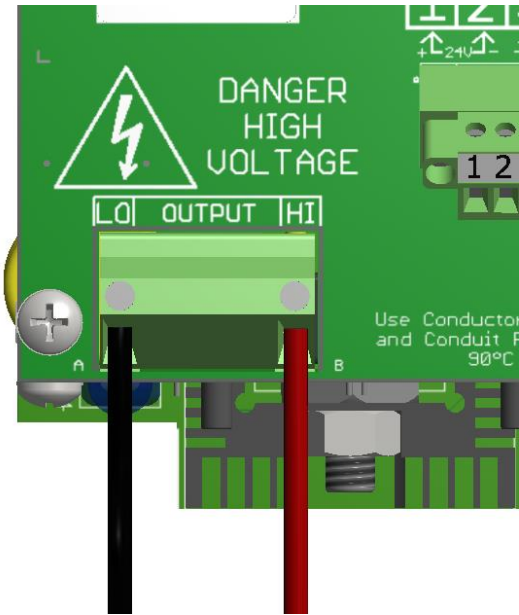


Figure 9: Correct connection of output harness wires with 1/2in NPT Male Harness.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

SURESPARK LO MANUAL

PAGE 15 OF 28

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

Chentronics®

TOLERANCE NOTES
FABRICATED TOLERANCES
≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

Next, unscrew the cover on the base rod and install the other end of the harness to the base rod by following the provided manufacturer instructions for cable-gland installation. Connect the **black** harness wire to the green ground terminal (Figure 10) and tighten it. Next, connect the remaining harness wire (**red** or **white**) to the rod wire using either the ceramic wire nut or the brass inline connector. For the ceramic wire nut option, twist the wires together and terminate the connection by inserting the twisted pair into the ceramic wire nut and tightening it by hand. For the brass inline connector option, pull back the white sleeve on the base rod wire to reveal the brass inline connector, make the connection, and **pull the sleeve back to insulate the connector.**

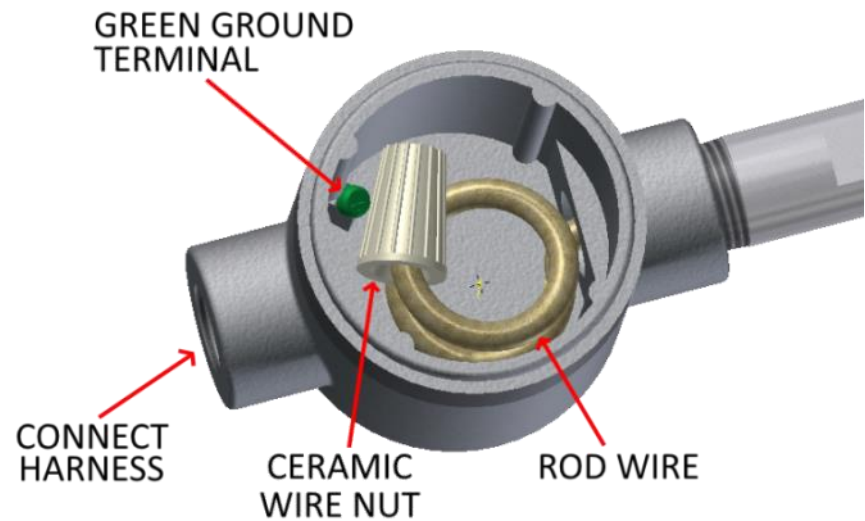


Figure 10: The case of the base rod.

NOTICE: Verify the rod wire is fully connected to the harness wire (RED or WHITE).

4.5 02 Series Igniter and Extension Rod Installation

To install the extension rod or igniter, press the male connector into the female connector and fully hand-tighten it.




Figure 11: Series 02 igniter/extension rod connection.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

SURESPARK LO MANUAL

PAGE 16 OF 28

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)

< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)

± 0.010 DECIMAL DIM (2 PLACES)

± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

4.6 Coaxial Output Harness and Igniter Installation

The exciter output is characterized as a high current transient pulse. It is good practice to separate ignition cables from signal cables to prevent noise coupling. However, the ignition circuit is unaffected by other (nearby) ignition sources, and multiple ignition cables can share the same tray.

Connect the harness to the output connector on the enclosure and wrench-tighten. Repeat this process on the other end of the harness to connect the harness to the igniter. See Figure 12.

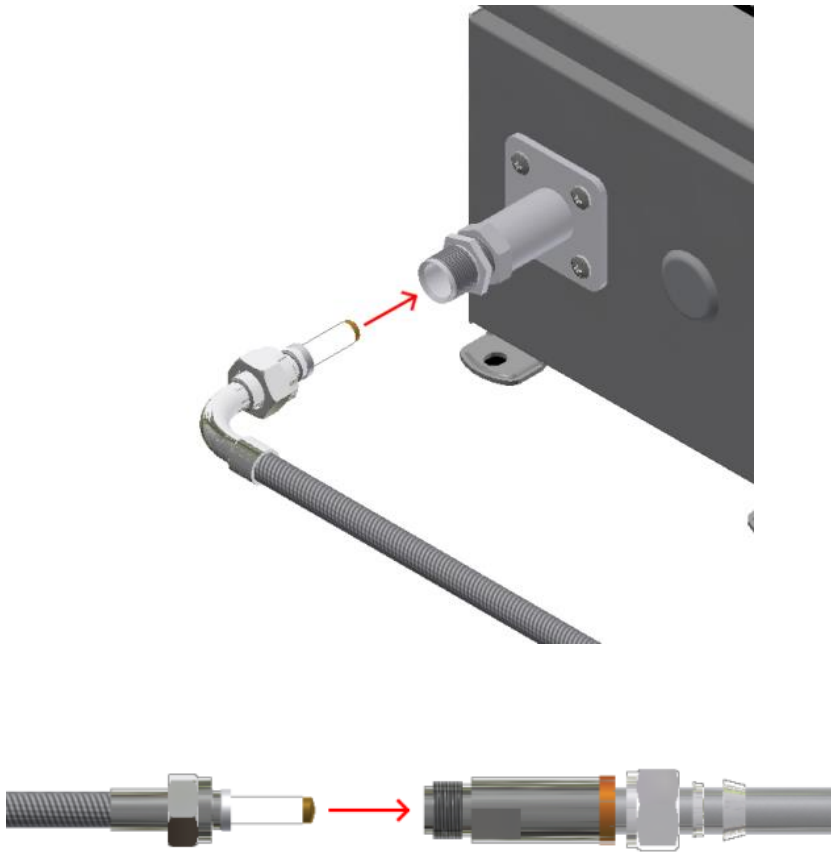


Figure 12: ARP 670 Coaxial Harness connections.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

SURESPARK LO MANUAL

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

PAGE 17 OF 28

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES
≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY CHENTRONICS. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO CHENTRONICS. FOR MORE INFORMATION PLEASE CONTACT CHENTRONICS AT +1.607.334.5531.

4.7 Safety wire Installation (Optional)

For applications in which electrical connections may be exposed to vibration, Chentronics® recommends that the customer further secure ARP connections with safety wire. This is a common practice in Aerospace as it helps prevent ARP connections from loosening during use. Please follow the installation instructions as stated in Figure 13 and Figure 14

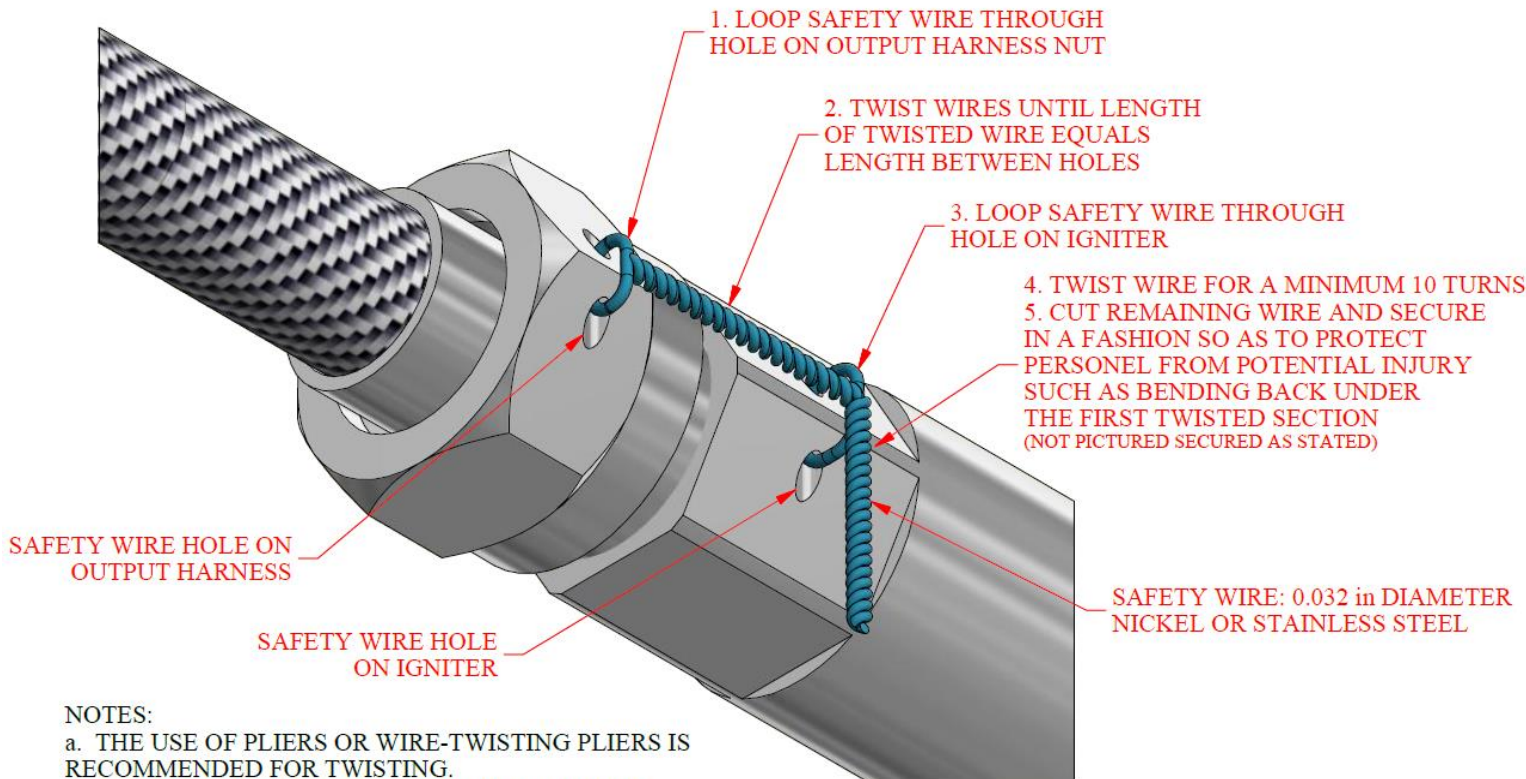


Figure 13: Safety Wire Installation – Output Harness to Igniter

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

SURESPARK LO MANUAL

PAGE 18 OF 28

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

Chentronics®

TOLERANCE NOTES
FABRICATED TOLERANCES
≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY CHENTRONICS. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO CHENTRONICS. FOR MORE INFORMATION PLEASE CONTACT CHENTRONICS AT +1.607.334.5531.

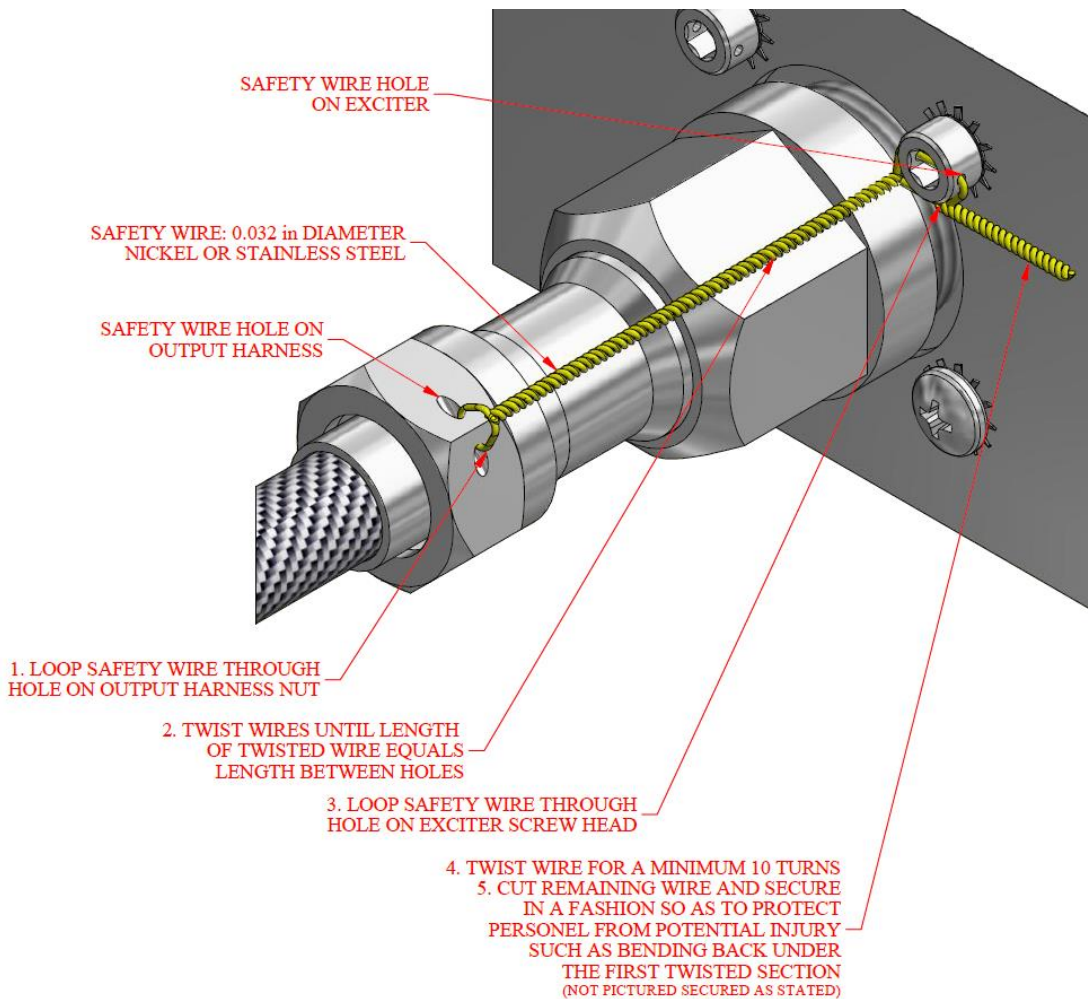


Figure 14: Safety Wire Installation – Output Harness to Exciter

4.8 Wiring Installation

Single unit exciter wiring

The SureSpark™ High Energy Exciter includes two enclosure entries for power/control. Wiring must be rated at least 90°C. Connections should be made only when the equipment and wiring are not energized. Once connected, the wiring should not be removed from the exciter until it has been de-energized for at least 5 minutes.

The ignition circuit is unaffected by other (nearby) ignition sources, and multiple ignition cables can share the same tray.

To power the exciters, apply 100-240VAC at 50/60 Hz between terminals L1 and L2 and connect the terminals marked with the ground symbol \perp to earth ground.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

SURESPARK LO MANUAL

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

PAGE 19 OF 28

Chentronics®

TOLERANCE NOTES
FABRICATED TOLERANCES
 ≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
 < 2 ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
 ± 0.050 DECIMAL DIM (1 PLACE)
 ± 0.010 DECIMAL DIM (2 PLACES)
 ± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL


THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

Dual unit exciter internal wiring

One set of contacts is used to fire both exciters, and wear indicator (fault) contacts for both exciters are wired in series.

CUSTOMER WIRING: —

CHENTRONICS PRE- WIRING: - - - - - -

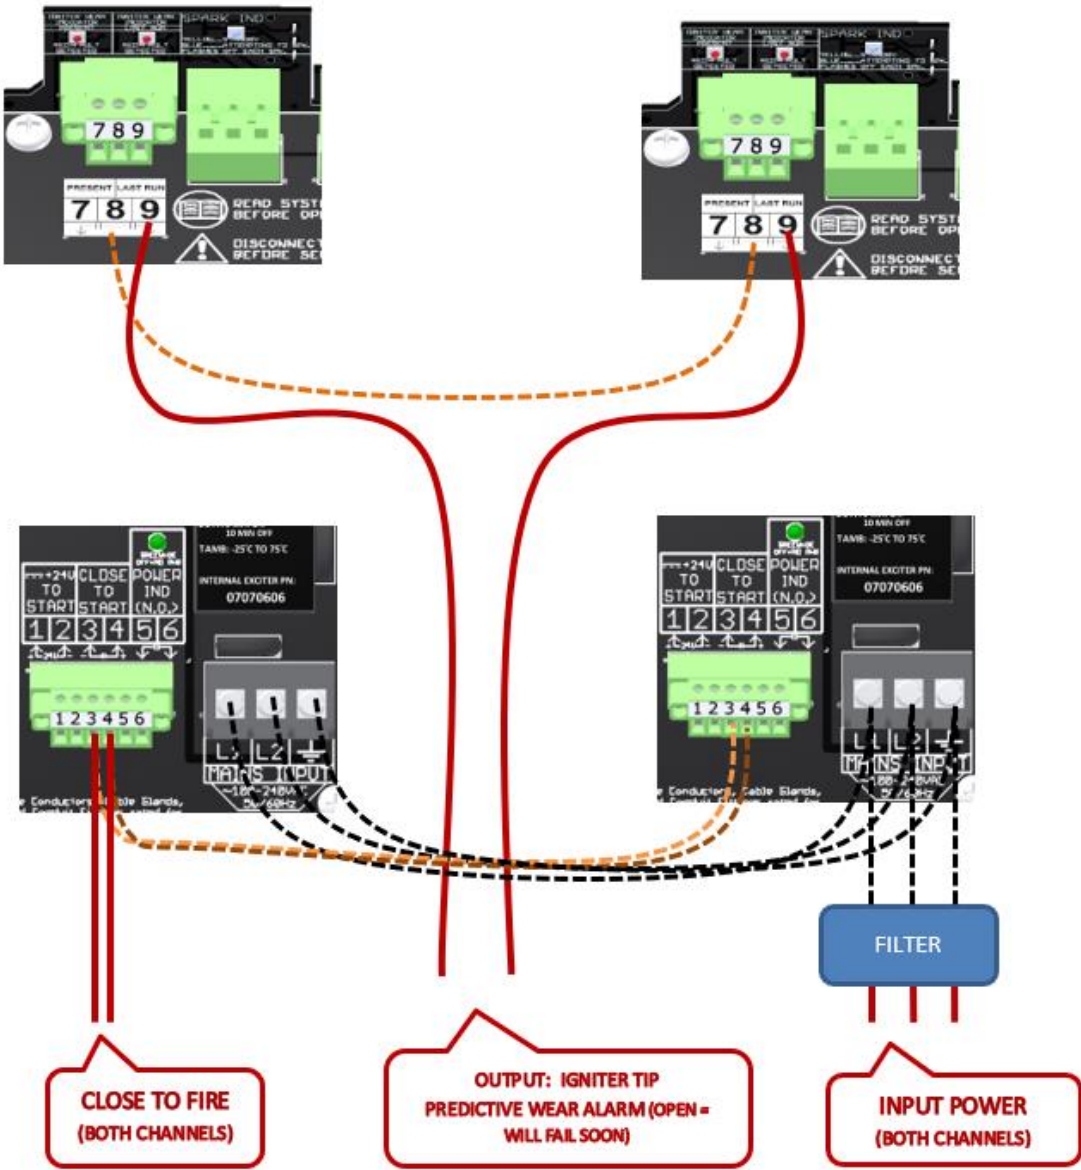

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
 AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES
ISO 9001 CERTIFIED

DRAWN BY:
 AR
ON:
 2022-MAR-04

LAST REV BY:
 xyz
ON:
 x/y/z

SURESPARK LO MANUAL

PAGE 20 OF 28

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES
≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

Dual unit exciter input power wiring

There is an EMI filter located at the bottom of the enclosure. Both exciters are already wired into the EMI filter. Crimp the three provided connectors to Line wire (L1), Neutral (N), and Ground (G) and attach connectors to the EMI filter.

INPUT POWER:

- CONNECT LINE POWER TO TERMINALS ON EMI FILTER.
- BOTH EXCITER CHANNELS WILL POWER FROM SINGLE SOURCE.



MISC. EQUIPMENT:

- 3 CONNECTORS INCLUDED
- QUICK CONNECTOR, FULLY INSULATED, 14-16AWG, 0.25in (6.5mm).
- PROVIDED TO USER FOR CONNECTING POWER TO EMI FILTER.



4.9 Installing the Igniter into a Burner

Consult the burner manufacturer's instruction manual for igniter installation into your specific burner. Clamp the igniter rod or metal harness using metal fixtures/clamps.

4.10 Equipment Earth Bond

The main earth bond is located at the input power terminal for each module (see below).

All modules should connect separately to a single earth ground. For example, an enclosure with two modules should have individual wires from each earth terminal to the earth ground.

Provide additional enclosure earth bonds per local electrical installation code, if required.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

SURESPARK LO MANUAL

PAGE 21 OF 28

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

Chentronics

TOLERANCE NOTES

FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)

< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES


± 0.050 DECIMAL DIM (1 PLACE)

± 0.010 DECIMAL DIM (2 PLACES)

± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

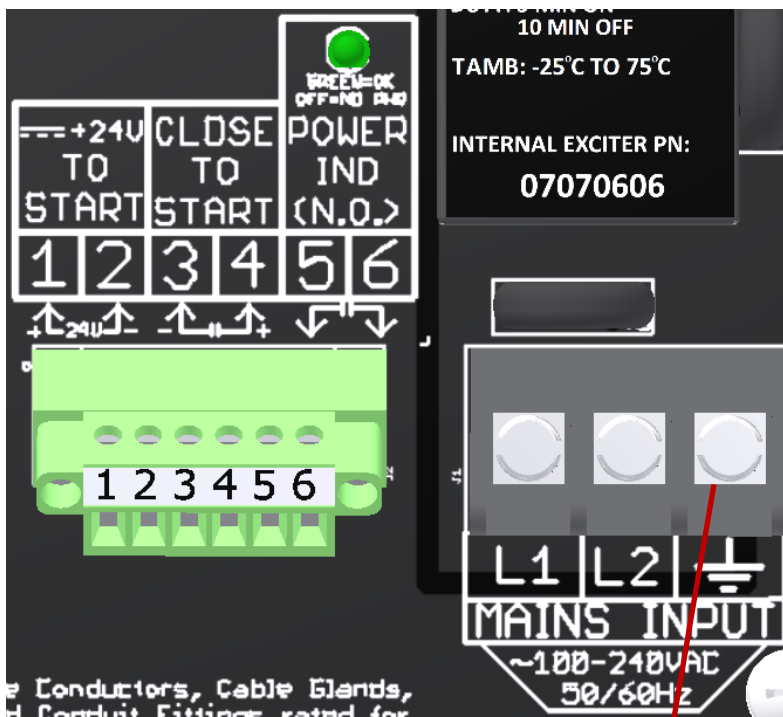

EARTH GROUND
TERMINAL

Figure 15: Earth grounding terminal

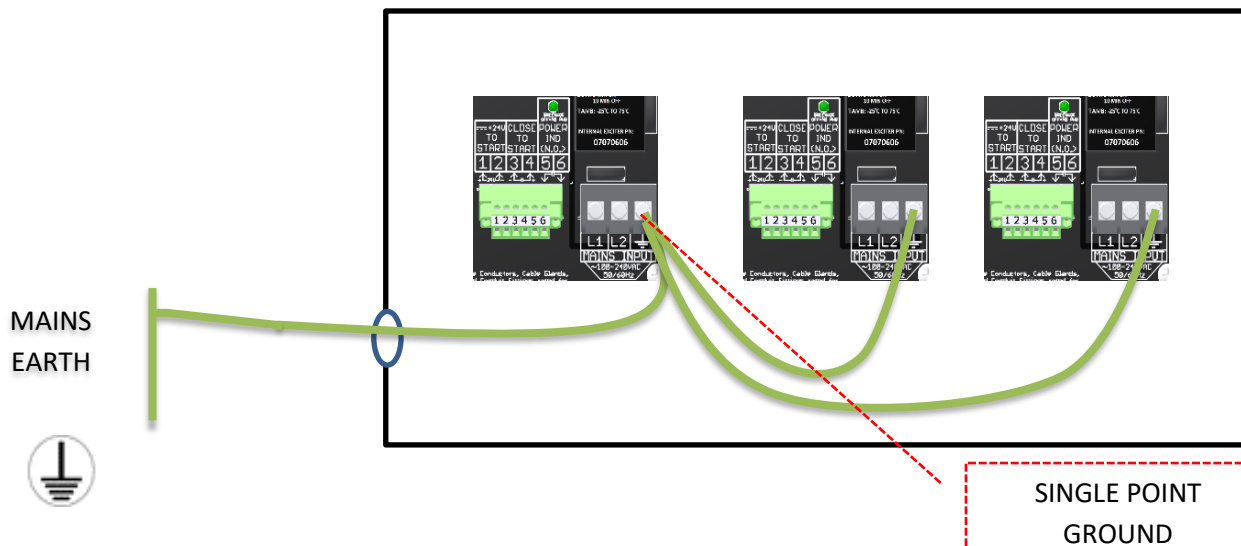


Figure 16: Earthing example (Single point ground)

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY:

AR

ON:

2022-MAR-04

LAST REV BY:

xyz

ON:

x/y/z

SURESPARK LO MANUAL

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

PAGE 22 OF 28

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES
 ≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
 < 2 ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
 ± 0.050 DECIMAL DIM (1 PLACE)
 ± 0.010 DECIMAL DIM (2 PLACES)
 ± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY CHENTRONICS. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO CHENTRONICS. FOR MORE INFORMATION PLEASE CONTACT CHENTRONICS AT +1.607.334.5531.

5.0 System Operational Inputs and Outputs

5.1 Terminal Key

The following functions illustrate the input and output functionality of the exciter.

MAINS TERMINAL

L1

L2

\perp

OUTPUT TERMINAL

HI

LO

TERMINAL DESCRIPTION

Input power (L1/HOT) wire, 14AWG min., 300V min.

Input power (L2/NEUTRAL) wire, 14AWG min., 300V min.

Input (EARTH GROUND) wire, 14AWG, 300V min.

TERMINAL DESCRIPTION

Output, Igniter center wire, 14AWG min., 2400V min.

Output, Igniter shell return, 14AWG min., 2400V min.

Return wire must connect directly from this output to the harness/igniter shell, NOT to the enclosure chassis.

NOTE: Chentronics® harnesses and igniters are designed to operate with Chentronics® exciters.

+24V TO START

1-2

TERMINAL DESCRIPTION

Input Spark Control – Applying a 24V_{DC} signal to these terminals will energize the exciter to spark. The current draw is approximately 6mA.

CLOSE TO START

3-4

TERMINAL DESCRIPTION

Input Spark Control – Closing terminals 3-4 using a ZVC signal or a jumper wire will energize the exciter to spark. The relay must withstand 24V_{DC} when open and 40mA when closed.

NOTICE: Do not simultaneously connect the +24V TO START terminals and the CLOSE TO START terminals.

POWER INDICATOR

5-6

TERMINAL DESCRIPTION

Provides a closed contact output signal when the proper input voltage is applied. Contact rating: 250VAC / 355VDC max; 240mA max; 16-22 AWG

IGNITER WEAR: PRESENT

7-8

TERMINAL DESCRIPTION

Provides a closed contact output signal when the spark rate exceeds the minimum.

Provides an open contact output signal when the spark rate is less than the minimum.

Contact rating: 250VAC / 355VDC max; 240mA max; 16-22 AWG

IGNITER WEAR: LAST RUN

8-9

TERMINAL DESCRIPTION

Provides a latched open contact output signal when igniter wear is detected. Contacts will remain open until a start signal is re-applied, at which point they will reset closed until another fault is found. Pin 8 is common between terminals 7 and 9.

Contact rating: 250VAC / 355VDC max; 240mA max; 16-22 AWG

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS AND TRADEMARKS PLEASE SEE CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

SURESPARK LO MANUAL

PAGE 23 OF 28

DRAWN BY: AR
ON: 2022-MAR-04

LAST REV BY: xyz
ON: x/y/z

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

Chentronics®

TOLERANCE NOTES
FABRICATED TOLERANCES
 ≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
 < 2ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
 ± 0.050 DECIMAL DIM (1 PLACE)
 ± 0.010 DECIMAL DIM (2 PLACES)
 ± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.



HAZARDOUS VOLTAGE

Do not separate any cables from the enclosure until the power has been disconnected for 5 minutes, and do not energize the cable while it is disconnected from the enclosure.

TENSION DANGEREUSE

Ne pas séparer les câbles du boîtier jusqu'à ce que le courant a été coupé pendant 5 minutes, et ne pas alimenter le câble tandis qu'il est déconnecté du boîtier.









STARTLING NOISE

Igniters can make a loud "snapping" or "popping" noise when fired. Anticipate this noise and warn others to expect it before operating the equipment. Alert others in the area before operating equipment.

BRUITS SAISSANTS/SURPRENANTS

Les allumeurs peuvent faire un fort bruit de « claquement » ou un bruit « sec » lors de l'allumage. Anticipez ce bruit et avertissez les autres de s'attendre à ce bruit avant de faire fonctionner l'équipement. Alertez tout individu dans la zone avant de faire fonctionner l'équipement.

5.2 Electrical Area Classification and Safety Markings

LO-2 AND LO-4 INTERNAL CERTIFICATIONS		LO-2 AND LO-4 EXTERNAL CERTIFICATIONS	
<div>RECOGNIZED COMPONENT</div> <div> C US</div> <div>Intertek</div> <div>USA: CLASS I DIVISION 2 GROUPS ABCD T3A CANADA: CLASS I DIVISION 2 GROUPS ABCD T3A</div> <div>INTERNAL UNIT TESTED PER THE FOLLOWING STANDARDS: USA» UL 1012, UL 121201 CANADA» CSA C22.2#213, CSA C22.2#107.1</div>		<div></div> <div>TESTED PER THE FOLLOWING STANDARDS: EUROPE» EN 61000-6-2, EN 61000-6-2, EN 61010, EN 63000 UK» EN 61000-6-2, EN 61000-6-2, EN 61010, EN 63000</div>	
LOTS SYSTEM CERTIFICATIONS			
<div></div> <div>II 3 G Ex db nA IIC T4 Gc IP65 Exciter: -25°C ≤ Ta ≤ +75°C Barrier Glands: -25°C ≤ Ta ≤ +100°C Harness: -40°C ≤ Ta ≤ +240°C ITS19ATEX44842</div>		<div>MODEL GTLO-1-4</div> <div></div> <div>Ex d nA IIC T4 (IP65) 20-GA4BO-0767X</div>	
<div></div> <div>Ex db nA IIC T4 Gc IP65 Exciter: -25°C To +75°C Barrier Glands: -25°C To +100°C Harness: -40°C To +240°C IECEx ETL 19.0022</div>		<div>MODEL GTLO-2-4</div> <div></div> <div>Ex d nA IIC T4 (IP65) 20-GA4BO-0768X</div>	

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
 AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY: AR
 ON: 2022-MAR-04

LAST REV BY: xyz
 ON: x/y/z

SURESPARK LO MANUAL

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

PAGE 24 OF 28

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES
 ≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
 < 2 ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
 ± 0.050 DECIMAL DIM (1 PLACE)
 ± 0.010 DECIMAL DIM (2 PLACES)
 ± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

5.3 System Schematic Diagram

The following schematic block diagram describes equipment functionality.

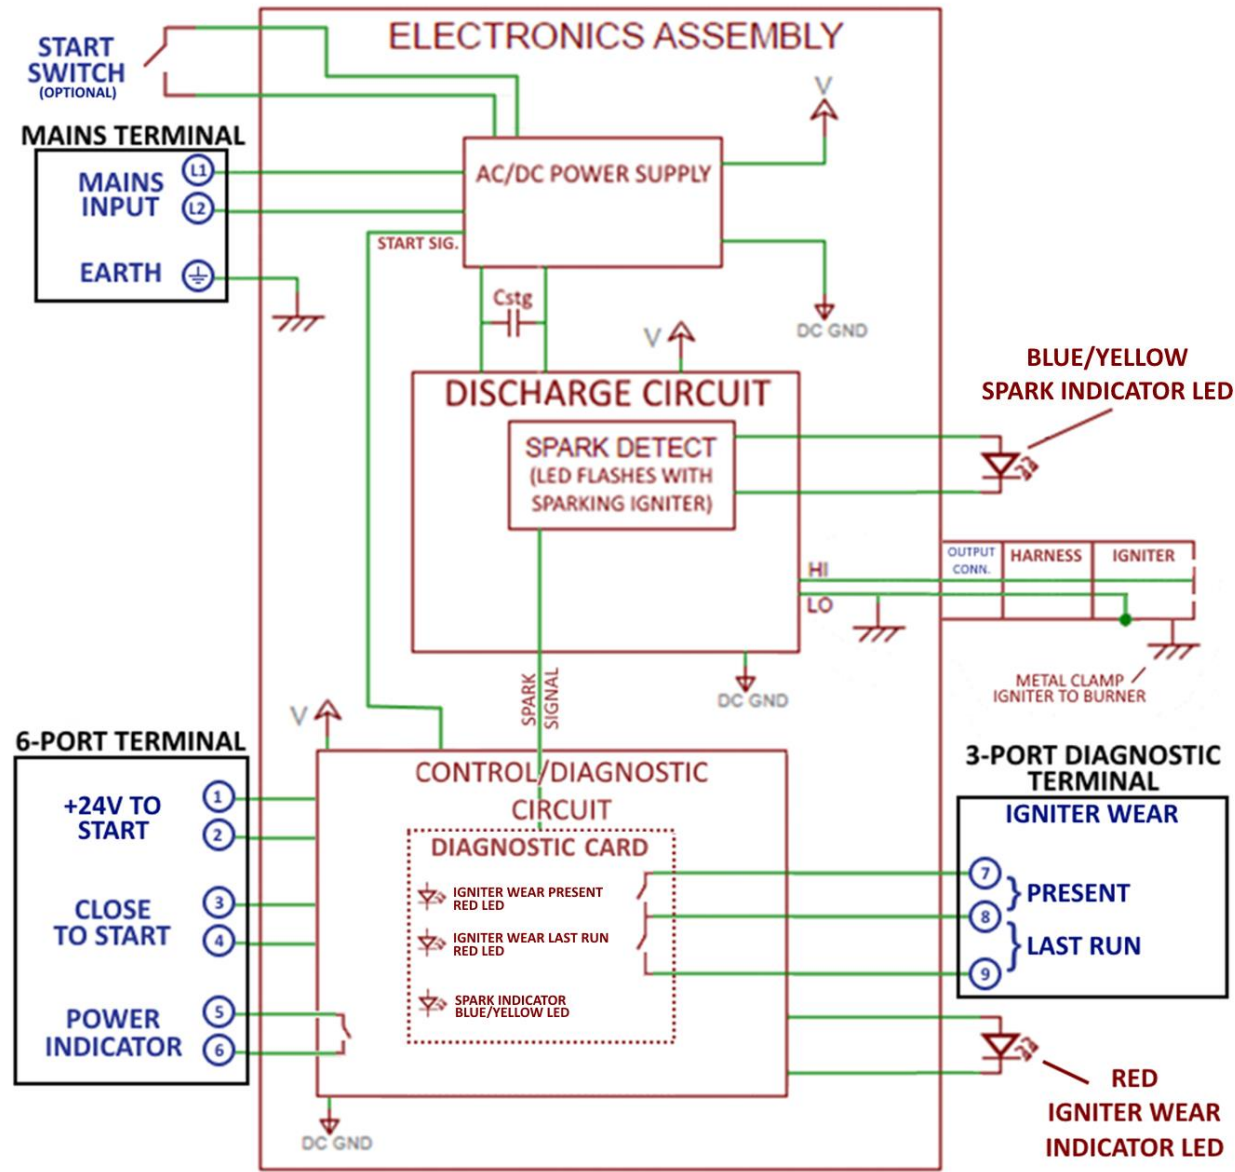


Figure 17: System schematic diagram.

5.4 Firing the Igniter

If a jumper is connected between pins 3 and 4 on the top board (CLOSE TO START Terminal), applying mains power to the input power terminals will begin sparking the igniter immediately. If a jumper is not used, the unit will power up in standby mode and can be fired using one of the following methods:

- Apply 24 V_{DC} between terminals 1 and 2 (+24V TO START) to spark the igniter.
- Close (apply a ZVC signal) between terminals 3 and 4 (CLOSE TO START) to spark the igniter.
- If included, use the switch on the enclosure to fire the exciter.

NOTICE: Enclosure switches come in momentary (hold to fire) and sustained (push on/push off) varieties.

NOTICE: Do not simultaneously connect the +24V TO START terminals and the CLOSE TO START terminals. See Section 5.0.

5.5 Spark Indicator

The SureSpark™ High Energy Exciter system is equipped with a yellow/blue LED enclosure spark indicator which will visually represent the functionality of the Exciter circuit. The LED indicator is on the front of the enclosure and flashes off steadily whenever a spark occurs. If the LED is off, power is not applied to the exciter. If the LED is on solid Yellow, the exciter is in standby mode and ready to fire. If the LED is Blue and flashing constantly, the igniter is firing correctly. If the LED is Blue and flashing intermittently, the igniter tip is reaching the end of life and needs to be replaced. Finally, if the LED is solid Blue, the igniter tip has failed and must be replaced. See Table 1 for a quick reference.

Table 1: LED Indicator Key

Always Off	OFF	Device Not Powered
Solid	YELLOW	Ready to Fire (Standby)
Steady Rate	BLUE	Normal Operation
Intermittent	BLUE	Igniter tip near end of life (replace soon)
Solid	BLUE	The igniter tip is at the end of life (replace now)

5.6 Igniter Wear Detection

The spark diagnostic feature gives the exciter the ability to detect igniter faults. See Section 5.0 for a description of the IGNITER WEAR: PRESENT and IGNITER WEAR: LAST RUN terminals. There are also LEDs that correspond to these terminals. The IGNITER WEAR: PRESENT LED turns on when the spark rate drops below the threshold. The IGNITER WEAR: LAST RUN LED turns on when the spark rate falls below the threshold and stays off until the next start signal is applied. This LED is located both on the exciter and on the enclosure's front panel. The diagnostic card also includes a blue/yellow Spark Indicator LED, which serves the same function as the external Spark Indicator (See Section 5.5).

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

SURESPARK LO MANUAL

PAGE 26 OF 28

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

 Chentronics

TOLERANCE NOTES**FABRICATED TOLERANCES**

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)

< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)

± 0.010 DECIMAL DIM (2 PLACES)

± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

6.0 Maintenance

6.1 Service

The unit is not field-repairable. The exciter internal electronic assembly may be replaced on-site, but the power must be disconnected for at least five minutes before the cover is unlocked and removed.

NOTICE: Be sure to note all connections carefully before removing the exciter internal assembly. Reconnect new internal assembly in the same manner. Incorrect connections or failure to connect all leads can damage the equipment.

6.2 Cleaning

EXCITER – Remove debris that may have accumulated inside the exciter enclosure with a vacuum or non-metallic brush.

HARNESS – Do not use acid or carbon tetrachloride as cleaning agents on conduits or harnesses. Clean the exterior with a stiff non-metallic brush moistened with cleaning solvents. Protect cable terminations from solvent contamination during cleaning. Heat or oil stains, which persist on the conduit after cleaning, are permissible.

BASE ROD – The ceramic well at the Base Rod end of the rod should be sprayed with a cleaning solvent or alcohol and, if necessary, cleaned with a lint-free rag.

EXTENSION ROD – The rod's ceramic well at the igniter end should be sprayed with a cleaning solvent or alcohol and, if necessary, cleaned with a lint-free rag. The ceramic terminal end should be cleaned with a cleaning solvent or alcohol.

IGNITER TIP – The ceramic terminal end should be cleaned with a cleaning solvent or alcohol. The tip should be sprayed to remove oil or other hydrocarbons that may contaminate the ceramic surface. Do not clean with a wire brush.



HAZARDOUS VOLTAGE

Disconnect power before servicing the equipment.

TENSION DANGEREUSE

Coupez l'alimentation avant l'entretien du matériel.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY:

AR

ON:

2022-MAR-04

LAST REV BY:

xyz

ON:

x/y/z

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

SURESPARK LO MANUAL

PAGE 27 OF 28

TOLERANCE NOTES
FABRICATED TOLERANCES
≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

SURESPARK LO MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

7.0 Standard Components and Accessories

The following is a sample of standard parts available with the SureSpark™ High Energy Exciter system. For additional parts and technical drawings, please get in touch with Chentronics®.

7.1 Standard 2-Wire Output System Components

Harnesses – 2-Wire MS3102A Connection PN: 03000300

Base Rods – 2-Wire MS3102A to 02 Series PN: 02000300

Extension Rods – 02 Series connection PN: 02000400

Igniters – 02 Series connection PN: 02000500

NOTE: Contact Chentronics® for additional component selection.

7.2 Standard ARP 670 Coaxial System Components

Harnesses – ARP 670 connection PN: RP44613NI

Igniters – ARP 670 connection PN: 09002233

NOTE: Contact Chentronics® for additional component selection.

7.3 Standard Explosion Proof Enclosure System Components

Harnesses – 2-Wire Male Barrier-Gland PN: 06000115

Base Rods – Barrier Gland to 02 Series PN: 02600300

Extension Rods – 02 Series connection PN: 02000400

Igniters – 02 Series connection PN: 02000500

NOTE: Contact Chentronics® for additional component selection.

8.0 Warranty Instructions

For warranty-related inquiries, please get in touch with Chentronics® at TEL: +1.607.334.5531 or info@chentronics.com.

9.0 Technical Support

For technical support-related inquiries beyond the scope of this Installation and Operation Manual, please get in touch with Chentronics® at TEL: +1.607.334.5531 or info@chentronics.com.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

CDM-139, CDM-140, CDM-206, CDM-111, CDM-112, CDM-114, CDM-180

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY:
AR

ON:
2022-MAR-04

LAST REV BY:
xyz

ON:
x/y/z

SURESPARK LO MANUAL

DCO No. 14804

DWG. No. MNL-SURESPARK LO

REV. F

PAGE 28 OF 28

Chentronics®