

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)

< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)

± 0.010 DECIMAL DIM (2 PLACES)

± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.



DSF-2010-SB



KEEP THIS MANUAL IN A SAFE PLACE FOR FUTURE REFERENCE!

Read this manual before using this product. Failure to follow the instructions and safety precautions in this manual can result in serious injury or death or damage to equipment.

Applicable Scanner Part Numbers

PART NUMBER	TYPE (SB, MB)	AREA (NON-HAZ, HAZ)	TEMP RATING	KEY FEATURE	INPUT PINS
2653-271-11	SB	NON-HAZ	-30°C to 70°C	Auto-Gain	14
2653-271-05	SB	HAZ	-30°C to 70°C	Auto-Gain	10

Contact Technical Support +1.866.821.5504 with any questions.

For a list of relevant patents and trademarks, please see <http://www.chentronics.com/legal-notice>

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
[CHENTRONICS.COM/LEGAL-NOTICES](http://www.chentronics.com/legal-notice)

ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 1 OF 23

DRAWN BY:
AR

ON:
2022-NOV-01

LAST REV BY:

ON:


DCO No.

15135

DWG. No. MNL-ISCAN2SB

REV. J

Chentronics

<p>TOLERANCE NOTES FABRICATED TOLERANCES ≥ 2 ft (610 mm) ± 0.250 in (6.4 mm) < 2ft (610 mm) ± 0.125 in (3.2 mm) MACHINED TOLERANCES ± 0.050 DECIMAL DIM (1 PLACE) ± 0.010 DECIMAL DIM (2 PLACES) ± 0.005 DECIMAL DIM (3 PLACES)</p>	<p>INSTALLATION & OPERATION MANUAL</p>	<p>THIS DRAWING OWNED BY CHENTRONICS. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO CHENTRONICS. FOR MORE INFORMATION PLEASE CONTACT CHENTRONICS AT +1.607.334.5531.</p>																																																																																																															
<p>Contents</p> <table><tr><td>1</td><td>Important Safety Information</td><td>3</td></tr><tr><td>2</td><td>Customer Support</td><td>4</td></tr><tr><td>3</td><td>Electrical Area Classification and Safety Markings.....</td><td>5</td></tr><tr><td>3.1</td><td>Description of Equipment Protection System</td><td>5</td></tr><tr><td>3.2</td><td>Hazardous Area</td><td>5</td></tr><tr><td>3.3</td><td>Non-hazardous Area</td><td>6</td></tr><tr><td>4</td><td>General.....</td><td>7</td></tr><tr><td>4.1</td><td>Product Description</td><td>7</td></tr><tr><td>4.2</td><td>Views of Models.....</td><td>7</td></tr><tr><td>4.2.1</td><td>Non-hazardous Area (PN 2653-271-11)</td><td>7</td></tr><tr><td>4.2.2</td><td>Hazardous Area (PN 2653-271-05)</td><td>7</td></tr><tr><td>4.3</td><td>Product Features.....</td><td>8</td></tr><tr><td>4.3.1</td><td>Programmability</td><td>8</td></tr><tr><td>4.3.2</td><td>Digital Signal Processing with Self Check.....</td><td>8</td></tr><tr><td>4.3.3</td><td>Electronically Assisted Sighting Indicator (EASI).....</td><td>8</td></tr><tr><td>4.3.4</td><td>Configurable Flame Relays</td><td>8</td></tr><tr><td>4.4</td><td>Technical Specifications</td><td>9</td></tr><tr><td>4.4.1</td><td>Definitions</td><td>9</td></tr><tr><td>4.4.2</td><td>Specification Table</td><td>10</td></tr><tr><td>4.4.3</td><td>Default Configuration (Settings).....</td><td>11</td></tr><tr><td>5</td><td>Wiring Instructions.....</td><td>12</td></tr><tr><td>5.1</td><td>Shielding Single Point Ground Connection.....</td><td>12</td></tr><tr><td>5.2</td><td>Non-Hazardous Area Model (14 Wire) Installations</td><td>13</td></tr><tr><td>5.3</td><td>Hazardous Area Model (10 Wire) Installations</td><td>15</td></tr><tr><td>5.4</td><td>Communication Wiring Detail</td><td>17</td></tr><tr><td>5.4.1</td><td>“Daisy Chain” Configuration</td><td>18</td></tr><tr><td>5.4.2</td><td>Split or “Y” Configuration</td><td>19</td></tr><tr><td>6</td><td>Non-hazardous Area Model and Hazardous Area Model Mounting</td><td>20</td></tr><tr><td>6.1</td><td>Purge Air Connections.....</td><td>20</td></tr><tr><td>6.2</td><td>Mounting Instructions:.....</td><td>20</td></tr><tr><td>6.3</td><td>Non-hazardous Area Model (PN 2653-271-12) General Arrangement.....</td><td>21</td></tr><tr><td>6.4</td><td>Hazardous Area Model (PN 2653-271-05) General Arrangement</td><td>21</td></tr><tr><td>7</td><td>Sighting the Scanner</td><td>22</td></tr><tr><td>7.1</td><td>Flame Line of Sight</td><td>22</td></tr><tr><td>7.2</td><td>Sighting Non-hazardous Area Models.....</td><td>23</td></tr><tr><td>7.3</td><td>Sighting Hazardous Area Models</td><td>23</td></tr><tr><td>8</td><td>Maintenance</td><td>23</td></tr></table>			1	Important Safety Information	3	2	Customer Support	4	3	Electrical Area Classification and Safety Markings.....	5	3.1	Description of Equipment Protection System	5	3.2	Hazardous Area	5	3.3	Non-hazardous Area	6	4	General.....	7	4.1	Product Description	7	4.2	Views of Models.....	7	4.2.1	Non-hazardous Area (PN 2653-271-11)	7	4.2.2	Hazardous Area (PN 2653-271-05)	7	4.3	Product Features.....	8	4.3.1	Programmability	8	4.3.2	Digital Signal Processing with Self Check.....	8	4.3.3	Electronically Assisted Sighting Indicator (EASI).....	8	4.3.4	Configurable Flame Relays	8	4.4	Technical Specifications	9	4.4.1	Definitions	9	4.4.2	Specification Table	10	4.4.3	Default Configuration (Settings).....	11	5	Wiring Instructions.....	12	5.1	Shielding Single Point Ground Connection.....	12	5.2	Non-Hazardous Area Model (14 Wire) Installations	13	5.3	Hazardous Area Model (10 Wire) Installations	15	5.4	Communication Wiring Detail	17	5.4.1	“Daisy Chain” Configuration	18	5.4.2	Split or “Y” Configuration	19	6	Non-hazardous Area Model and Hazardous Area Model Mounting	20	6.1	Purge Air Connections.....	20	6.2	Mounting Instructions:.....	20	6.3	Non-hazardous Area Model (PN 2653-271-12) General Arrangement.....	21	6.4	Hazardous Area Model (PN 2653-271-05) General Arrangement	21	7	Sighting the Scanner	22	7.1	Flame Line of Sight	22	7.2	Sighting Non-hazardous Area Models.....	23	7.3	Sighting Hazardous Area Models	23	8	Maintenance	23
1	Important Safety Information	3																																																																																																															
2	Customer Support	4																																																																																																															
3	Electrical Area Classification and Safety Markings.....	5																																																																																																															
3.1	Description of Equipment Protection System	5																																																																																																															
3.2	Hazardous Area	5																																																																																																															
3.3	Non-hazardous Area	6																																																																																																															
4	General.....	7																																																																																																															
4.1	Product Description	7																																																																																																															
4.2	Views of Models.....	7																																																																																																															
4.2.1	Non-hazardous Area (PN 2653-271-11)	7																																																																																																															
4.2.2	Hazardous Area (PN 2653-271-05)	7																																																																																																															
4.3	Product Features.....	8																																																																																																															
4.3.1	Programmability	8																																																																																																															
4.3.2	Digital Signal Processing with Self Check.....	8																																																																																																															
4.3.3	Electronically Assisted Sighting Indicator (EASI).....	8																																																																																																															
4.3.4	Configurable Flame Relays	8																																																																																																															
4.4	Technical Specifications	9																																																																																																															
4.4.1	Definitions	9																																																																																																															
4.4.2	Specification Table	10																																																																																																															
4.4.3	Default Configuration (Settings).....	11																																																																																																															
5	Wiring Instructions.....	12																																																																																																															
5.1	Shielding Single Point Ground Connection.....	12																																																																																																															
5.2	Non-Hazardous Area Model (14 Wire) Installations	13																																																																																																															
5.3	Hazardous Area Model (10 Wire) Installations	15																																																																																																															
5.4	Communication Wiring Detail	17																																																																																																															
5.4.1	“Daisy Chain” Configuration	18																																																																																																															
5.4.2	Split or “Y” Configuration	19																																																																																																															
6	Non-hazardous Area Model and Hazardous Area Model Mounting	20																																																																																																															
6.1	Purge Air Connections.....	20																																																																																																															
6.2	Mounting Instructions:.....	20																																																																																																															
6.3	Non-hazardous Area Model (PN 2653-271-12) General Arrangement.....	21																																																																																																															
6.4	Hazardous Area Model (PN 2653-271-05) General Arrangement	21																																																																																																															
7	Sighting the Scanner	22																																																																																																															
7.1	Flame Line of Sight	22																																																																																																															
7.2	Sighting Non-hazardous Area Models.....	23																																																																																																															
7.3	Sighting Hazardous Area Models	23																																																																																																															
8	Maintenance	23																																																																																																															
<p>RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):</p>		<p>MNL-ISCANSB</p>																																																																																																															
<p>FOR A LIST OF RELEVANT PATENTS AND TRADEMARKS PLEASE SEE CHENTRONICS.COM/LEGAL-NOTICES</p> <p>ISO 9001 CERTIFIED</p>	<p>INSTALLATION & OPERATION MANUAL</p>																																																																																																																
<p>DRAWN BY: AR</p>	<p>ON: 2022-NOV-01</p>	<p>PAGE 2 OF 23</p>																																																																																																															
<p>LAST REV BY:</p>	<p>ON:</p>	<p>DCO No. 15135</p>																																																																																																															
		<p>DWG. No. MNL-ISCAN2SB</p>																																																																																																															
		<p>REV. J</p>																																																																																																															
<p></p>																																																																																																																	

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

1 Important Safety Information

IMPORTANT SAFETY INFORMATION

Read All Instructions before Using

The instructions provided in this manual have been prepared to serve as a general guide. It is intended for use by qualified personnel with knowledge of Equipment of this type. It is not intended to cover all possible variations in equipment or to provide for specific operating problems which may arise.

You are responsible for adhering to all warnings or cautions provided in this Manual.

In addition to any general safety measures provided in this Manual, you must comply with all current national, state, local and company safety regulations at all times.

Safety Symbols used in this manual comply with ISO 3864.



Indicates a hazard with a high level of risk which, if not avoided will result in death or serious injury.



Indicates a hazard with a medium level of risk which, if not avoided could result in death or serious injury.



Indicates a hazard with a low level of risk which, if not avoided will result in minor or moderate injury.



EXPLOSION HAZARD



Do not open the equipment cover or service the equipment if an explosive atmosphere may be present. Equipment must be installed and serviced by qualified personnel in accordance with applicable local and national codes, standards, and ordinances.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 3 OF 23

DRAWN BY:
AR

ON:
2022-NOV-01

LAST REV BY:

ON:

DCO No.

15135

DWG. No.

MNL-ISCAN2SB

REV. J


Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS
CONDITIONALLY LOANED AND IS TO BE RETURNED UPON
REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED
NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR
TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO
MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO
CHENTRONICS. FOR MORE INFORMATION PLEASE CONTACT
CHENTRONICS AT +1.607.334.5531.

2 Customer Support

For Technical Support

Inside USA Call: 866.821.5504

Outside USA Call: +1.607.334.5531

Website: www.chentronics.com

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 4 OF 23

DRAWN BY:

AR

ON:

2022-NOV-01

LAST REV BY:

ON:

DCO No.

15135

DWG. No.

MNL-ISCAN2SB

REV. J

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES
 ≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
 < 2 ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
 ± 0.050 DECIMAL DIM (1 PLACE)
 ± 0.010 DECIMAL DIM (2 PLACES)
 ± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

3 Electrical Area Classification and Safety Markings

3.1 Description of Equipment Protection System

Special Conditions of Use: The flying leads of the flame scanner shall be suitably protected against mechanical damage and terminated within a terminal or junction facility for the conditions of use.

3.2 Hazardous Area

The iScan2 DSF-2010 system hazardous area models have been assessed and comply with the following hazardous area standards:

NEC/CEC/ABS/EAC



CLASS I, DIVISION 1, GROUPS B, C, & D T5
 NEMA TYPE 4X
 SIL3



20140305-MH26433



21-2116223-PDA



RU C-US. ГБ04.В.00663

FM3610:2009UL, FM7610:1997

60730-2-5

ANSI Z21.20

FM3600:1998, FM3615:1989, FM3810:1989

CAN/CSA C22.2 No.

60079-0

ISA 60079-1:2002

CAN/CSA C22.2 No. 30

IEC 61508-1:2010, IEC 61508-2:2010, IEC 61508-3:2010

IECEX



Ex d IIC T5 Ta -30°C to +70°C

Ex tD A21 IP66 T100°C Ta -30°C to +70°C

IECEX FME 10.0004X

IEC 60079-0:2004

IEC 60079-1:2007

IEC 61241-0:2004

IEC 61241-1:2004

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS
 AND TRADEMARKS PLEASE SEE
 CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 5 OF 23

DRAWN BY:
 AR

ON:
 2022-NOV-01

LAST REV BY:

ON:

DCO No.

15135

DWG. No.

MNL-ISCAN2SB

REV. J

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

3.3 Non-hazardous Area

The iScan2 DSF-2010 system has been assessed and complies with the following safety standards:

NEC/CEC/ABS/CE/UKCA



NEMA TYPE 4X
SIL 3



20140305-MH26433



21-2116223-PDA



NB 2797 705806



AB 0086 751491

FM3610:2009UL, FM7610:1997

60730-2-5

CAN/CSA C22.2 No. 199-2007

ANSI Z21.20

IEC 61508-1:2010, IEC 61508-2:2010, IEC 61508-3:2010

EN 298:2012, EN 63000, EN 61000-6-4, EN 61000-6-2

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 6 OF 23

DRAWN BY:
AR

ON:
2022-NOV-01

LAST REV BY:

ON:

DCO No.

15135

DWG. No.

MNL-ISCAN2SB

REV. J

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES
≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

4 General

4.1 Product Description

The **iScan2** is designed for detecting burner flames of fossil fuels such as hydrogen blends and 100% hydrogen, natural gas, refinery gas, waste gas, fuel oils, biomass and coals. The iScan2 flame scanner consists of an integrated viewing head and signal processor. No secondary signal processor or amplifier is required.

4.2 Views of Models

4.2.1 Non-hazardous Area (PN 2653-271-11)



4.2.2 Hazardous Area (PN 2653-271-05)



RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCAN2SB

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 7 OF 23

DRAWN BY:
AR

ON:
2022-NOV-01

LAST REV BY:

ON:

DCO No.

15135

DWG. No.

MNL-ISCAN2SB

REV. J

Chentronics

TOLERANCE NOTES

FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)

< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)

± 0.010 DECIMAL DIM (2 PLACES)

± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY CHENTRONICS. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO CHENTRONICS. FOR MORE INFORMATION PLEASE CONTACT CHENTRONICS AT +1.607.334.5531.

4.4 Technical Specifications

4.4.1 Definitions

FLICKER – Flicker refers to the modulation of flame intensity due micro-explosions of the fuel.

FDORT – Flame Detector ON Response Time – the period of time from flame intensity rising above the user adjustable threshold to flame relay contacts closed.

FDRT – Flame Detector Response Time –the period of time between the loss of a sensed flame and the signal indicating the absence of flame.

MFFRT – Marginal Flame Fail Response Time – period of time from flame intensity falling below the user adjustable threshold to the flame relay contacts open.

EASI - Electronically Assisted Sight Indicator – refers to the red LED (Light Emitting Diode) located on the back of the Non-hazardous Area Models, that flashes to indicate flame intensity. When no flame is present the LED blinks approximately 1 time per second. When a flame is present the LED’s blink rate increases proportional to the flame intensity. At optimal sighting and scanner gain, the LED blinks at approximately 30 times per second. If the LED is on solid or off the scanner is faulted and should not be used.

GAIN – When a signal is amplified, GAIN is the ratio of the amplified signal relative to the original.

DISCRIMINATION – is the ability to distinguish between multiple flames. An example of good discrimination is when the MB scanner is able to recognize a pilot flame with other burner’s main fuel flame in the background. The status of the main (background) flame does not affect the ability to detect the pilot flame (ON or OFF).

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS AND TRADEMARKS PLEASE SEE CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY: AR

ON: 2022-NOV-01

INSTALLATION & OPERATION MANUAL

PAGE 9 OF 23

Chentronics

LAST REV BY:

ON:

DCO No. 15135

DWG. No. MNL-ISCAN2SB

REV. J

<div>TOLERANCE NOTES</div> <div>FABRICATED TOLERANCES</div> <div>≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)</div> <div>< 2ft (610 mm) ± 0.125 in (3.2 mm)</div> <div>MACHINED TOLERANCES</div> <div>± 0.050 DECIMAL DIM (1 PLACE)</div> <div>± 0.010 DECIMAL DIM (2 PLACES)</div> <div>± 0.005 DECIMAL DIM (3 PLACES)</div>	INSTALLATION & OPERATION MANUAL		THIS DRAWING OWNED BY CHENTRONICS. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO CHENTRONICS. FOR MORE INFORMATION PLEASE CONTACT CHENTRONICS AT +1.607.334.5531.	
4.4.2 Specification Table				
AREA CLASSIFICATION	Non-hazardous Area	Hazardous Area		
Part Number	PN 2653-271-11	PN 2653-271-05		
Area Classification	NEMA 4X, IP66	NEMA 4X and IP66 Class 1, Division 1, Groups B, C, & D CE 0359 II 2 G Ex d IIC T5 and II 2 D Ex tD A21 IP66 T100 °C Ta		
Input Cable	Quick Disconnect Separate Cable	Individual Wires Attached 10 Ft. (3 m) Long		
Weight	3.4 lb. (1.54 kg)	3.8 lb. (1.72 kg)		
Mounting	1" NPT(F)	1" NPT(F)		
Purge Air NOTE 1				
Flow	5 scfm (8.5 Nm³/hr)	5 scfm (8.5 Nm³/hr)		
Pressure	5" w.c. (13 mbar)	5" w.c. (13 mbar)		
EASI	Yes	No		
Optics	Quartz Lens	Quartz Lens		
Sensor Type	Solid-State	Solid-State		
Sensor Range	Ultraviolet Peak at 350 nm and Infrared Peak at 700 nm	Ultraviolet Peak at 350 nm and Infrared Peak at 700 nm		
Communication	USB/RS485: up to 127 scanners (with repeaters placed every 30 scanners) may be connected in one loop up to a distance of 4000 Ft. (1200 M).	USB/RS485: up to 127 scanners (with repeaters placed every 30 scanners) may be connected in one loop up to a distance of 4000 Ft. (1200 M).		
Temperature	-30°C to 70°C	-30°C to 70°C		
Humidity	0 to 100% Relative Humidity, Condensing	0 to 100% Relative Humidity, Condensing		
Input Power NOTE 2	24 ± 4 VDC Filtered 3.36 VA (140 mA) Per Scanner	24 ± 4 VDC Filtered 3.36 VA (140 mA) Per Scanner		
Relay Contacts NOTE 3	Normally Open Voltage Free Contacts (i.e. contacts close when flame is detected) 0.5 A @ 125 VAC Resistive Load; 0.3 A @ 230 VAC Resistive Load 1.0 A @ 24 VDC Resistive Load	Normally Open Voltage Free Contacts (i.e. contacts close when flame is detected) 0.5 A @ 125 VAC Resistive Load; 0.3 A @ 230 VAC Resistive Load 1.0 A @ 24 VDC Resistive Load		
Signal Output NOTES 4,5	Output #1, 4–20 mA, Flame Signal Output # 2, 4-20 mA, Map Auto Gain, Raw Signal, or Internal Scanner Temperature Maximum Current Loop Resistance = 750 ohms	Output #1, 4–20 mA, Flame Signal Maximum Current Loop Resistance = 750 ohms		
FDORT (FLAME ON)	2 seconds SUFFIX -4 Flame ON 1 second	2 seconds SUFFIX -4 Flame ON 1 second		
FDRT (FLAME OFF)	1 second SUFFIX -4 Flame OFF 4 seconds	1 second SUFFIX -4 Flame OFF 4 seconds		
MFRRT	2 seconds SUFFIX -4 Flame OFF 4 seconds	2 seconds SUFFIX -4 Flame OFF 4 seconds		
RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):		MNL-ISCANSB		
FOR A LIST OF RELEVANT PATENTS AND TRADEMARKS PLEASE SEE CHENTRONICS.COM/LEGAL-NOTICES		INSTALLATION & OPERATION MANUAL		PAGE 10 OF 23
ISO 9001 CERTIFIED				
DRAWN BY: AR	ON: 2022-NOV-01			
LAST REV BY:	ON:	DCO No. 15135	DWG. No. MNL-ISCAN2SB	REV. J
				Chentronics

<div>TOLERANCE NOTES</div> <div>FABRICATED TOLERANCES</div> <div>≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)</div> <div>< 2ft (610 mm) ± 0.125 in (3.2 mm)</div> <div>MACHINED TOLERANCES</div> <div>± 0.050 DECIMAL DIM (1 PLACE)</div> <div>± 0.010 DECIMAL DIM (2 PLACES)</div> <div>± 0.005 DECIMAL DIM (3 PLACES)</div>	INSTALLATION & OPERATION MANUAL		<div>THIS DRAWING OWNED BY CHENTRONICS. IT IS</div> <div>CONDITIONALLY LOANED AND IS TO BE RETURNED UPON</div> <div>REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED</div> <div>NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR</div> <div>TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO</div> <div>MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO</div> <div>CHENTRONICS. FOR MORE INFORMATION PLEASE CONTACT</div> <div>CHENTRONICS AT +1.607.334.5531.</div>																																
<table><tr><td>AREA CLASSIFICATION</td><td>Non-hazardous Area</td><td>Hazardous Area</td></tr><tr><td>Part Number</td><td>PN 2653-271-11</td><td>PN 2653-271-05</td></tr><tr><td>Safety Integrity Level (SIL3) Data</td><td><div>PFDavg = 2.64 X 10-5</div><div>λS = 9.05 X 10-7</div><div>λDD = 2.81 X 10-7</div><div>λDU = 5.51 X 10-9</div><div>SFF = 99.5%</div><div>Proof Test Interval time = 1year NOTE 6</div></td><td><div>PFDavg = 2.64 X 10-5</div><div>λS = 9.05 X 10-7</div><div>λDD = 2.81 X 10-7</div><div>λDU = 5.51 X 10-9</div><div>SFF = 99.5%</div><div>Proof Test Interval time = 1year NOTE 6</div></td></tr></table>	AREA CLASSIFICATION	Non-hazardous Area	Hazardous Area	Part Number	PN 2653-271-11	PN 2653-271-05	Safety Integrity Level (SIL3) Data	<div>PFDavg = 2.64 X 10-5</div> <div>λS = 9.05 X 10-7</div> <div>λDD = 2.81 X 10-7</div> <div>λDU = 5.51 X 10-9</div> <div>SFF = 99.5%</div> <div>Proof Test Interval time = 1year NOTE 6</div>	<div>PFDavg = 2.64 X 10-5</div> <div>λS = 9.05 X 10-7</div> <div>λDD = 2.81 X 10-7</div> <div>λDU = 5.51 X 10-9</div> <div>SFF = 99.5%</div> <div>Proof Test Interval time = 1year NOTE 6</div>																										
AREA CLASSIFICATION	Non-hazardous Area	Hazardous Area																																	
Part Number	PN 2653-271-11	PN 2653-271-05																																	
Safety Integrity Level (SIL3) Data	<div>PFDavg = 2.64 X 10-5</div> <div>λS = 9.05 X 10-7</div> <div>λDD = 2.81 X 10-7</div> <div>λDU = 5.51 X 10-9</div> <div>SFF = 99.5%</div> <div>Proof Test Interval time = 1year NOTE 6</div>	<div>PFDavg = 2.64 X 10-5</div> <div>λS = 9.05 X 10-7</div> <div>λDD = 2.81 X 10-7</div> <div>λDU = 5.51 X 10-9</div> <div>SFF = 99.5%</div> <div>Proof Test Interval time = 1year NOTE 6</div>																																	
<div>NOTES:</div> <div><div>Note 1</div><div>Purge air pressure is the minimum differential pressure required between the purge air supply pressure at “Y” (scanner connection) and the back pressure.</div></div> <div><div>Note 2</div><div>24 VDC Power supply to iScan2 must not include any inductive load.</div></div> <div><div>Note 3</div><div>To achieve higher relay contact voltages, use iScan2 relay contacts to energize the coil of an interstitial relay.</div></div> <div><div>Note 4</div><div>Output for monitoring only. Not to be used to prove flame.</div></div> <div><div>Note 5</div><div>4-20 mA outputs are calibrated at the factory to a known load. Monitoring hardware will have an impact of the current output. For accurate readings, 4-20 mA output(s) should be calibrated using a milli-ammeter between the scanner’s 4-20 mA output and the monitoring hardware. Refer to the 4-20 ma Settings section MNL-iScan Software for details on how to execute the calibration procedure.</div></div> <div><div>Note 6</div><div>To maintain SIL3 rating for any system where the scanner is installed, scanners must be re-tested at an interval not to exceed one year. SIL3 rating for the system is void if scanners are not re-tested annually. Contact Chentronics to arrange re-test.</div></div>																																			
<div>4.4.3 Default Configuration (Settings)</div> <table><tr><td>Flame Detector On Response Time (FDORT)</td><td>2 seconds; SUFFIX -4 is 1 second</td></tr><tr><td>Flame Detector Response Time (FDRT)</td><td>1 second; SUFFIX -4 is 4 seconds</td></tr><tr><td>Marginal Flame Failure Response Time (MFFRT)</td><td>2 seconds; SUFFIX -4 is 4 seconds</td></tr><tr><td>Gain Configuration</td><td>Automatic</td></tr><tr><td>Gain Channel</td><td>High</td></tr><tr><td>Signal Gain</td><td>3.5 - 1000</td></tr><tr><td>Flame Flicker Frequency</td><td>26 Hz</td></tr><tr><td>Flame Flicker Bandwidth</td><td>12 Hz</td></tr><tr><td>Flame Flicker Threshold</td><td>-45 dB</td></tr><tr><td>Mains Filter</td><td>Enabled</td></tr><tr><td>Rail Filter</td><td>Enabled</td></tr><tr><td>Solar Filter</td><td>Enabled</td></tr><tr><td>Flame Filter</td><td>Enabled</td></tr></table> <div>The following settings apply to the overall scanner and not to an individual scanner file:</div> <table><tr><td>Communications Address</td><td>COMM 1 ^{NOTE 1}</td></tr><tr><td>Active File</td><td>A</td></tr><tr><td>4 To 20 mA Gain</td><td>1 mA/dB above threshold</td></tr></table> <div>NOTES:</div> <div><div>Note 1</div><div>As part of setup in iScan Software scanners are assigned unique addresses.</div></div>				Flame Detector On Response Time (FDORT)	2 seconds; SUFFIX -4 is 1 second	Flame Detector Response Time (FDRT)	1 second; SUFFIX -4 is 4 seconds	Marginal Flame Failure Response Time (MFFRT)	2 seconds; SUFFIX -4 is 4 seconds	Gain Configuration	Automatic	Gain Channel	High	Signal Gain	3.5 - 1000	Flame Flicker Frequency	26 Hz	Flame Flicker Bandwidth	12 Hz	Flame Flicker Threshold	-45 dB	Mains Filter	Enabled	Rail Filter	Enabled	Solar Filter	Enabled	Flame Filter	Enabled	Communications Address	COMM 1 ^{NOTE 1}	Active File	A	4 To 20 mA Gain	1 mA/dB above threshold
Flame Detector On Response Time (FDORT)	2 seconds; SUFFIX -4 is 1 second																																		
Flame Detector Response Time (FDRT)	1 second; SUFFIX -4 is 4 seconds																																		
Marginal Flame Failure Response Time (MFFRT)	2 seconds; SUFFIX -4 is 4 seconds																																		
Gain Configuration	Automatic																																		
Gain Channel	High																																		
Signal Gain	3.5 - 1000																																		
Flame Flicker Frequency	26 Hz																																		
Flame Flicker Bandwidth	12 Hz																																		
Flame Flicker Threshold	-45 dB																																		
Mains Filter	Enabled																																		
Rail Filter	Enabled																																		
Solar Filter	Enabled																																		
Flame Filter	Enabled																																		
Communications Address	COMM 1 ^{NOTE 1}																																		
Active File	A																																		
4 To 20 mA Gain	1 mA/dB above threshold																																		
<div>RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):</div> <div>MNL-ISCANSB</div>																																			
<div>FOR A LIST OF RELEVANT PATENTS AND TRADEMARKS PLEASE SEE CHENTRONICS.COM/LEGAL-NOTICES</div> <div>ISO 9001 CERTIFIED</div> <div>DRAWN BY: AR</div> <div>ON: 2022-NOV-01</div>	<div>INSTALLATION & OPERATION MANUAL</div>		<div>PAGE 11 OF 23</div> <div><div></div><div>Chentronics</div></div>																																
<div>LAST REV BY:</div> <div>ON:</div>	<div>DCO No.</div> <div>15135</div>	<div>DWG. No.</div> <div>MNL-ISCAN2SB</div>	<div>REV.</div> <div>J</div>																																

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)

< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)

± 0.010 DECIMAL DIM (2 PLACES)

± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.


5 Wiring Instructions

All wiring shall be done in accordance with all applicable local and national codes, standards, and ordinances.

The front Non-hazardous Area models use a quick disconnect scanner cable. This cable does not require a flexible conduit if permitted by local authority.

The Hazardous Area model has a ½" NPT (F) flexible conduit connection. The scanner cable for the hazardous area model shall be installed inside a grounded flexible conduit to protect it from mechanical damage and to reduce electrical noise interference. Connections for power, Earth Ground, and Flame Relay (N.O. and Common) are required for all applications. Use of the 4-20 mA outputs and Communications Bus, and connections are "as-required" for each application.

5.1 Shielding Single Point Ground Connection

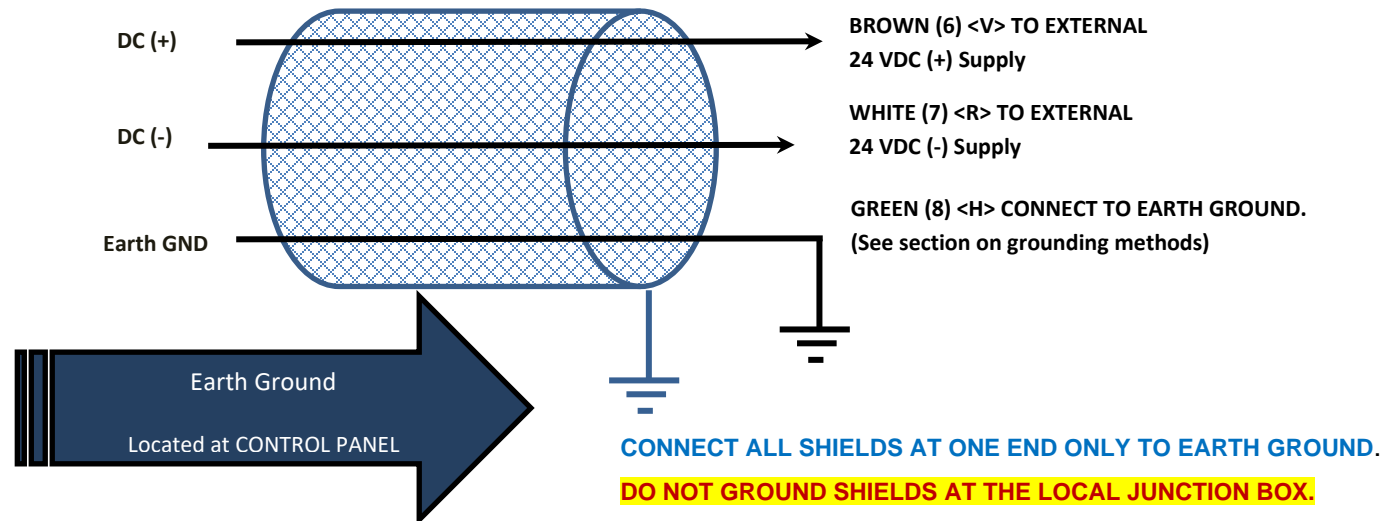

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 12 OF 23

DRAWN BY:
AR

ON:
2022-NOV-01

LAST REV BY:

ON:

DCO No.

15135

DWG. No.

MNL-ISCAN2SB

REV. J

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY CHENTRONICS. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO CHENTRONICS. FOR MORE INFORMATION PLEASE CONTACT CHENTRONICS AT +1.607.334.5531.



Electrical noise interference from high voltage/energy ignition sources can adversely affect the operation of the flame scanner. To minimize the possibility of electrical noise interfering with the operation of the flame scanner:

- Do **not** install ignition wires in the same conduit as the scanner wires.
- Ignition Systems shall have a dedicated return.
- Do **not** mount an ignition transformer in the same enclosure where the flame scanner wiring is terminated.
- Ignition cables shall be routed a minimum of 12" (305mm) from scanner wiring at all times.
- DSF-2010 complies with IEC 61000-4-3 (RF Radiated Immunity). However if a strong enough RF source, such as a portable radio, is within 3 m of the DSF-2010 or its cable operation may be adversely affected. For safe operation avoid introducing RF energy within 10' (3m) of the device to avoid false Flame On/Off indication.

5.2 Non-Hazardous Area Model (14 Wire) Installations

The wires on the non-hazardous area models are contained in overall shielded quick disconnect cable. Wires are #20 AWG; all wires are stripped and tinned. Use shielded twisted pair cables as noted in the wiring diagram for all functions from the quick connect cable to the instrument panel. Connect all the shields at one end only to earth ground at the control panel. Do not ground the shields at the local junction boxes.

NOTE: Do not ground the shields at the local junction boxes.

1. If more than one 24 VDC supply is required, the 24 VDC returns labeled as "DC (-)" shall be connected to each other. The 24 VDC return line shall be isolated from earth ground.
2. If more than one 24 VDC supply is required, the 24 VDC returns labeled as "DC (-)" shall be connected to each other. The 24 VDC return line shall be isolated from earth ground.
3. If more than one 24 VDC supply is required, the 24 VDC source connections labeled as "DC (+)" shall be isolated from all other power supplies. If switching power supplies are used the supplies may be connected via a wired OR diode configuration.

NOTE: the BLOCKING DIODE must be rated for a minimum of 50 volts and 10 Amps.

4. File Select is not available on SB models.
5. The 24 VDC return, "DC (-)", is the return for the 4–20 mA output loop(s). Input must be isolated type. Maximum current loop resistance is 750 ohms.
6. Connect the scanner Earth GND (Green, 8, <H>) to EARTH GROUND. A short BRAIDED CONDUCTOR (alternately a short AWG #12 wire) is recommended.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 13 OF 23

DRAWN BY:
AR

ON:
2022-NOV-01

LAST REV BY:

ON:

DCO No.

15135

DWG. No.

MNL-ISCAN2SB

REV. J

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)

< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)


± 0.010 DECIMAL DIM (2 PLACES)

± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

All shields are tied to EARTH GROUND in the Control Panel only.

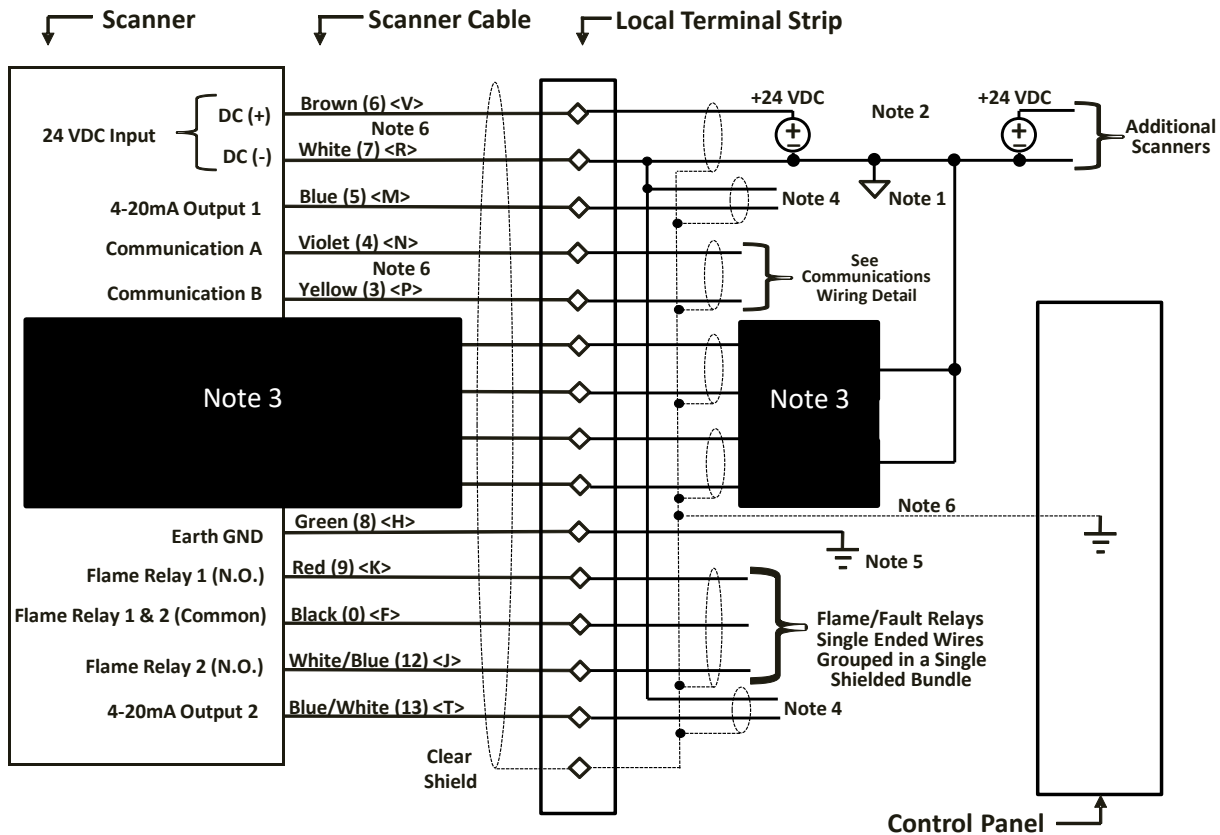

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 14 OF 23

DRAWN BY:
AR

ON:
2022-NOV-01

LAST REV BY:

ON:

DCO No.

15135

DWG. No. MNL-ISCAN2SB

REV. J

Chentronics

<div>TOLERANCE NOTES</div> <div>FABRICATED TOLERANCES</div> <div>≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)</div> <div>< 2ft (610 mm) ± 0.125 in (3.2 mm)</div> <div>MACHINED TOLERANCES</div> <div>± 0.050 DECIMAL DIM (1 PLACE)</div> <div>± 0.010 DECIMAL DIM (2 PLACES)</div> <div>± 0.005 DECIMAL DIM (3 PLACES)</div>	INSTALLATION & OPERATION MANUAL	THIS DRAWING OWNED BY CHENTRONICS. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO CHENTRONICS. FOR MORE INFORMATION PLEASE CONTACT CHENTRONICS AT +1.607.334.5531.
<div>5.3 Hazardous Area Model (10 Wire) Installations</div> <div>The hazardous area model has black wires and is numbered as shown. Wires are #24 AWG; all wires are stripped and tinned. Use shielded twisted pair cables as noted in the wiring diagram for all functions from the scanner to the instrument panel. Connect all the shields at one end only to earth ground at the control panel. Do not ground the shields at the local junction boxes.</div> <div><div>Note 2</div><div>If more than one 24 VDC supply is required, the 24 VDC returns labeled as “DC (-)” shall be connected to each other. The 24 VDC return line shall be isolated from earth ground.</div></div> <div><div>Note 3</div><div>If more than one 24 VDC supply is required, the 24 VDC source connections labeled as “DC (+)” shall be isolated from all other power supplies. If switching power supplies are used the supplies may be connected via a wired OR diode configuration.</div></div> <div><div>NOTE: the BLOCKING DIODE must be rated for a minimum of 50 volts and 10 Amps.</div></div> <div><div>Note 4</div><div>File Select is not available on SB models.</div></div> <div><div>Note 5</div><div>The 24 VDC return, “DC (-)”, is the return for the 4–20 mA output loop(s). Input must be isolated type. Maximum current loop resistance is 750 ohms.</div></div> <div><div>Note 6</div><div>Connect the scanner Earth GND (GRN (8)) to EARTH GROUND. A short BRAIDED CONDUCTOR (alternately a short AWG #12 wire) is recommended.</div></div> <div><div>Note 7</div><div>All shields are tied to EARTH GROUND in the Control Panel only.</div></div> <div>All conductors are black except Earth GND (GRN (8)) which is green/yellow. Older models have a wraparound cloth label with the wire numbers. Recent models have a sleeve of color coded heat shrink at both ends of the conductor with the wire number printed on it. The corresponding wire number/color is shown in the diagram below, for example BLK (6) [Brown].</div>		
RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):		MNL-ISCANSB
<div>FOR A LIST OF RELEVANT PATENTS AND TRADEMARKS PLEASE SEE CHENTRONICS.COM/LEGAL-NOTICES</div> <div>ISO 9001 CERTIFIED</div> <div>DRAWN BY: AR</div> <div>ON: 2022-NOV-01</div>		<div>INSTALLATION & OPERATION MANUAL</div> <div>PAGE 15 OF 23</div> <div>Chentronics</div>
LAST REV BY:	ON:	<div>DCO No.</div> <div>15135</div> <div>DWG. No.</div> <div>MNL-ISCAN2SB</div> <div>REV. J</div>

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)

< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES


± 0.050 DECIMAL DIM (1 PLACE)

± 0.010 DECIMAL DIM (2 PLACES)

± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

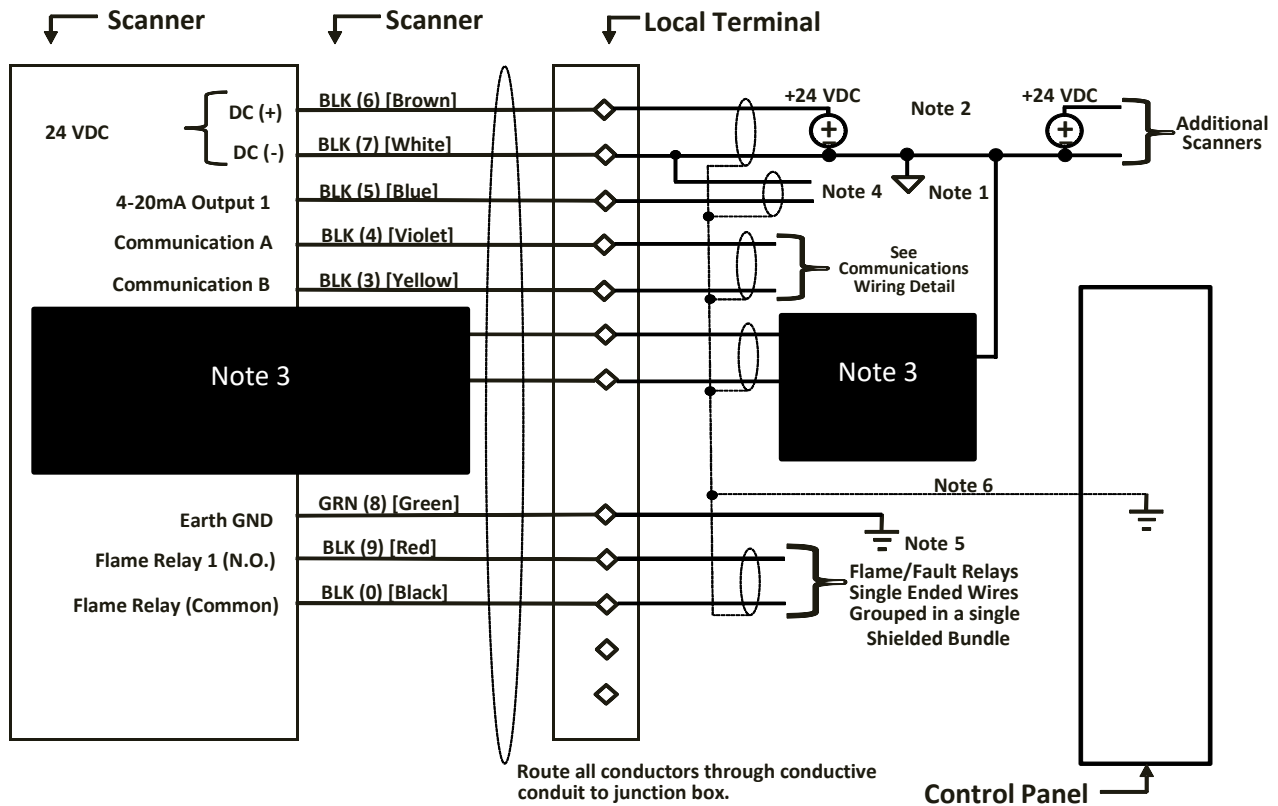

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 16 OF 23

DRAWN BY:
AR

ON:
2022-NOV-01

LAST REV BY:

ON:

DCO No.

15135

DWG. No.

MNL-ISCAN2SB

REV. J

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)

< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)

± 0.010 DECIMAL DIM (2 PLACES)

± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

5.4 Communication Wiring Detail

Communication with the iScan2 is RS-485 via a USB to RS-485 Converter (PN 3425-057-01). RS-485 is a differential multi-drop network. For iScan2, the network is a half-duplex, 2-wire, echo-off configuration operating at 19200 KBAUD. The maximum allowable number of nodes on a given section of the network is 32 including the USB to RS-485 converter and any repeaters. If more than 32 loads are connected (1 USB converter, 1 RS-485 repeater and 30 iScan2s) then an RS-485 repeater is required between sections to boost the signal. The repeater must be compatible with the EIA-485 standard, must have input to output DC isolation, must operate on 24VDC over the operating temperature range of -30°C to +70°C and must have agency approvals sufficient to meet the area classification. B&B Electronics 485 repeater model 485OPDRI-PH meets these requirements. Additional repeaters may be added to extend the network to 127 scanners.

NOTE: When calculating 32 loads, include the USB to RS-485 converter and the number of repeaters in a section). For the extended sections, up to 30 iScan2s may be connected. The maximum length of any given section is 4000 FT (1200 M).

If using the B&B Electronics 485 repeater model referred to above, configure the DIP switches on ports as follows:

1	2	3	4	5	6	7	8
ON	ON	ON	ON	OFF	OFF	ON	OFF

Note 1: In this configuration TDA and RDA are connected as TDB and RDB so either TD or RD terminals will work.

Note 2: The green screw terminal on the case is for earth ground, not the GND terminals.

Since there is no dedicated signal reference, the 24 VDC return labeled as DC (-) is used. The USB to RS-485 and the Repeaters must have their GND terminals connected to the DC (-) as well. Failure to provide the signal reference may result in communication errors and potentially damage the iScan2.

The recommended topology is “Daisy Chain” as shown in the wiring diagrams below. A split or Y configuration is acceptable. **NO OTHER CONFIGURATION IS ACCEPTABLE.** Please refer to the EIA-485 specification for further information on RS-485 networks.

COMMUNICATION WIRING SUMMARY:

- Wiring must be twisted pair shielded cable. Ground the shield only at the control panel to prevent ground loops.
- Use only “Daisy Chain” or “Y” configurations. Connect all of the “Com A” wires together. Connect all of the “Com B” wires together. Make sure that the “Com A” and “Com B” wires are connected to the correct terminals on the converter.
- An RS-485 repeater is required for every 30 scanners or 4000 ft (1200 m) of length for a maximum of 127 scanners in a network.
- Ensure the DC (-) of all scanners are tied together as a reference for RS-485 communications. The GND terminal of the USB to RS-485 converter and the repeaters must also be connected to the DC (-) of the scanners.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 17 OF 23

DRAWN BY:
AR

ON:
2022-NOV-01

LAST REV BY:

ON:

DCO No.

15135

DWG. No.

MNL-ISCAN2SB

REV. J


Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES
 ≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
 < 2 ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
 ± 0.050 DECIMAL DIM (1 PLACE)
 ± 0.010 DECIMAL DIM (2 PLACES)
 ± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

5.4.1 “Daisy Chain” Configuration

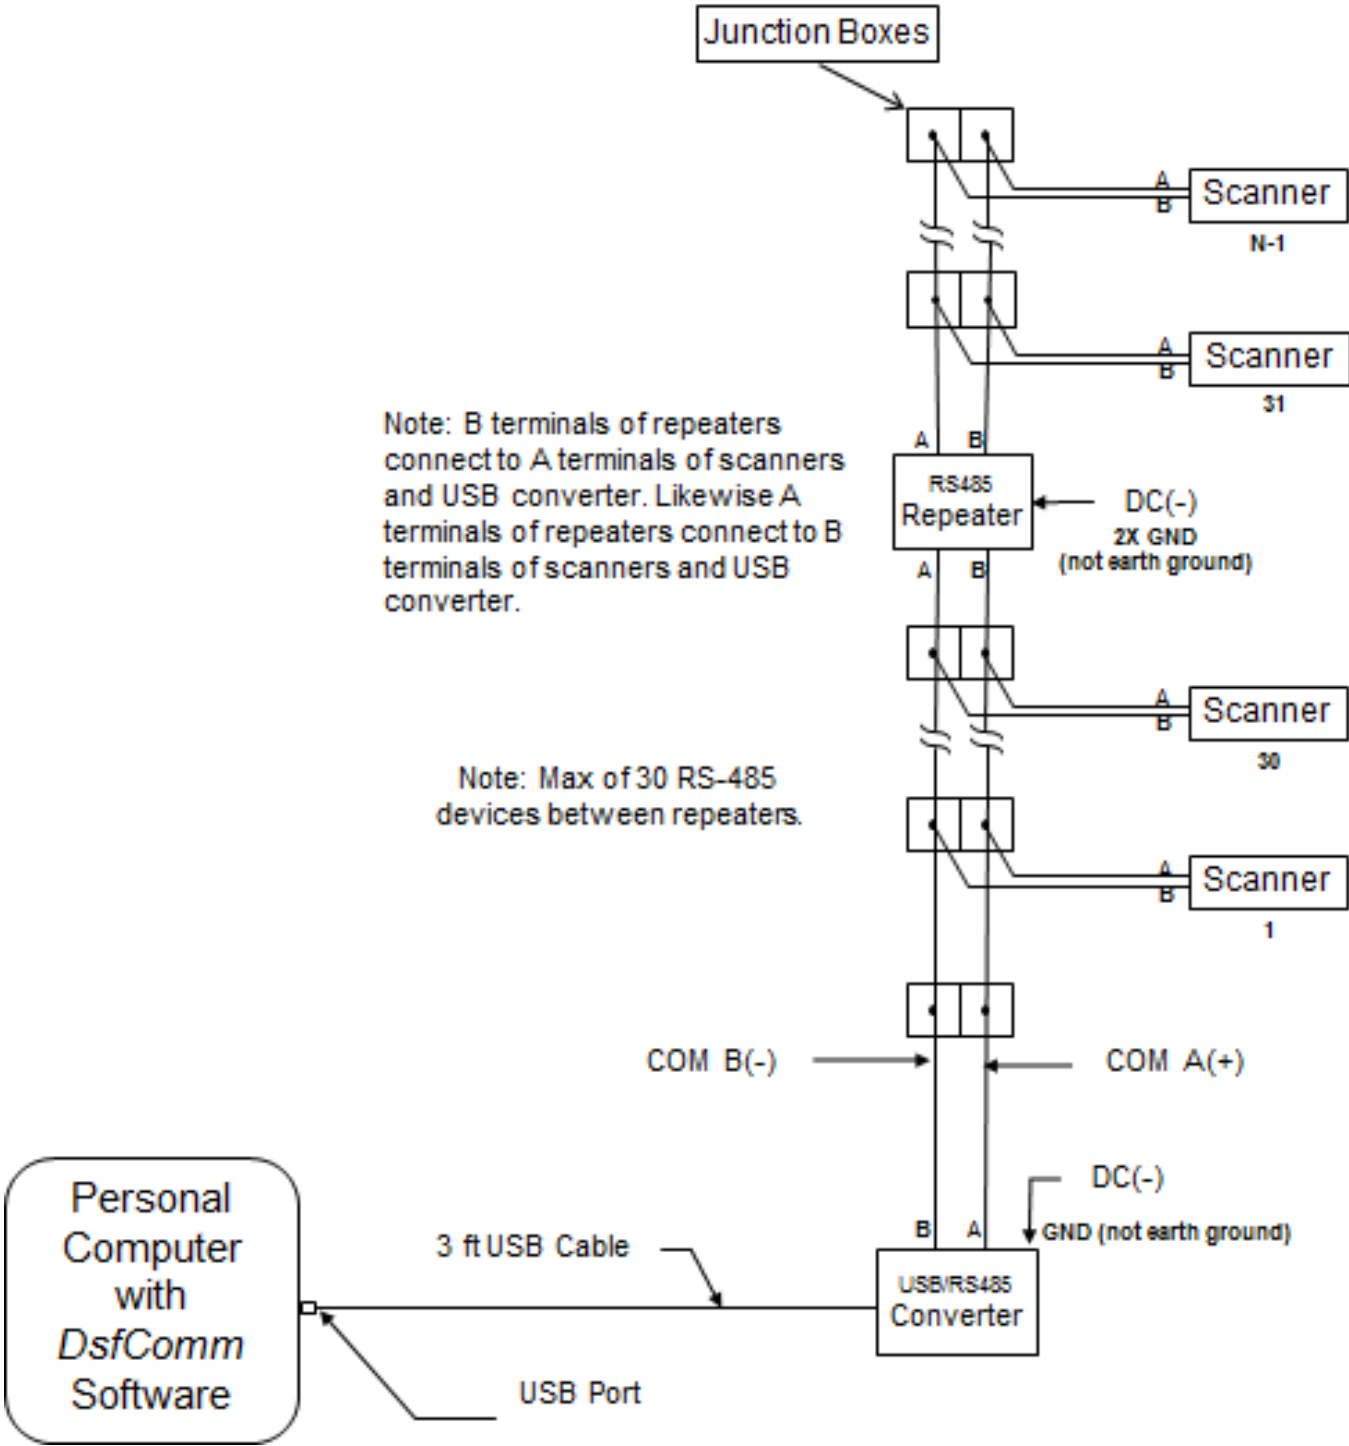

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS AND TRADEMARKS PLEASE SEE CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 18 OF 23

DRAWN BY: AR
 ON: 2022-NOV-01

LAST REV BY: ON:

DCO No.
 15135

DWG. No. MNL-ISCAN2SB

REV. J




TOLERANCE NOTES
FABRICATED TOLERANCES
 ≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
 < 2 ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
 ± 0.050 DECIMAL DIM (1 PLACE)
 ± 0.010 DECIMAL DIM (2 PLACES)
 ± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

5.4.2 Split or “Y” Configuration

Note: B terminals of repeaters connect to A terminals of scanners and USB converter. Likewise A terminals of repeaters connect to B terminals of scanners and USB converter.

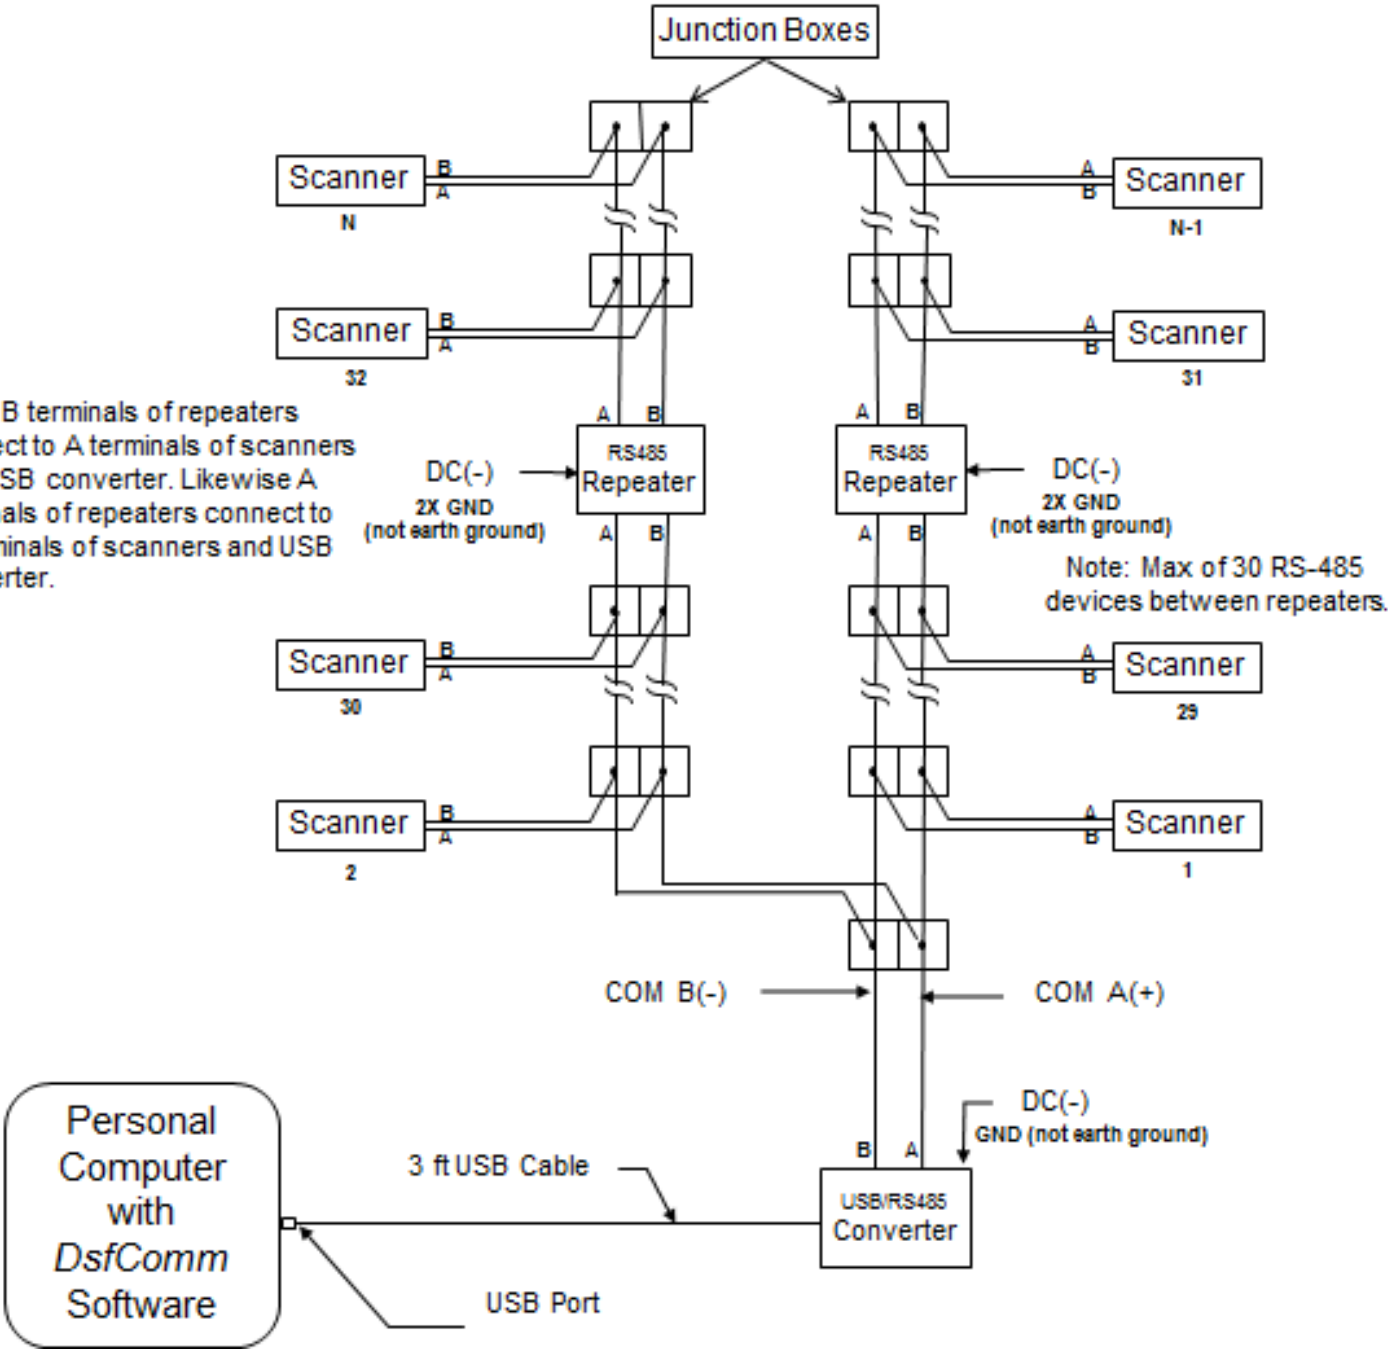

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCAN2SB

FOR A LIST OF RELEVANT PATENTS AND TRADEMARKS PLEASE SEE CHENTRONICS.COM/LEGAL-NOTICES
 ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 19 OF 23

DRAWN BY: AR
 ON: 2022-NOV-01

LAST REV BY: ON:

DCO No.
 15135

DWG. No. MNL-ISCAN2SB

REV. J

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)
± 0.010 DECIMAL DIM (2 PLACES)
± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

6 Non-hazardous Area Model and Hazardous Area Model Mounting

6.1 Purge Air Connections

The iScan2 flame scanners (Non-hazardous Area Model and Hazardous Area Model) have a 1" NPT (F) mounting connection. Use of a swivel mount assembly is recommended to permit proper sighting adjustment of the flame scanner. (See Section "SIGHTING THE SCANNER" for instructions).

6.2 Mounting Instructions:

- STEP 1** Remove the mounting ring and the mounting adapter from the scanner by unscrewing the mounting ring.
- STEP 2** Slip the mounting ring over the scanner mount.
- STEP 3** Thread the mounting adapter onto the scanner mount and tighten by hand only.
- STEP 4** Attach the scanner housing to the mounting adapter with the mounting ring and tighten by hand only.
- STEP 5** Avoid a sharp bend radius of scanner cable's quick disconnect. Provide strain relief if required in order to maintain proper seating for the quick disconnect connectors.

NOTE: The mounting ring must be tightened and removed by hand only to allow for ease of removal and to prevent mechanical damage.

- STEP 6** For applications requiring **CE** marking, specifically for EN298:2012, the input cable (PN 2649-026) must have ferrite added to meet CISPR 14-1. The ferrite must be installed within 6" (15 cm) of the scanner body. The cable must pass through the ferrite 3 times as shown in the picture below.



Ferrite is manufactured by Fair-Rite. Part number is 0431177081.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

DRAWN BY:
AR

ON:
2022-NOV-01

LAST REV BY:

ON:

DCO No.

15135

DWG. No.

MNL-ISCAN2SB

REV. J

INSTALLATION & OPERATION MANUAL

PAGE 20 OF 23


Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES
 ≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
 < 2 ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
 ± 0.050 DECIMAL DIM (1 PLACE)
 ± 0.010 DECIMAL DIM (2 PLACES)
 ± 0.005 DECIMAL DIM (3 PLACES)


INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

6.3 Non-hazardous Area Model (PN 2653-271-12) General Arrangement

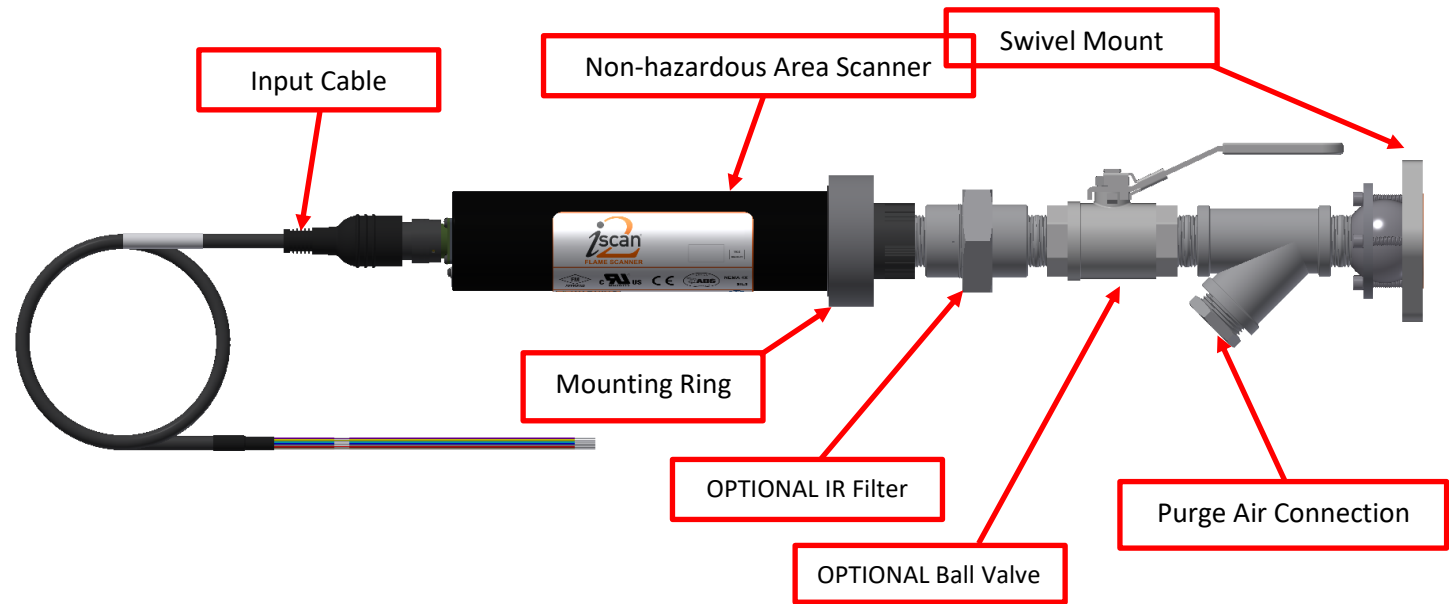

6.4 Hazardous Area Model (PN 2653-271-05) General Arrangement

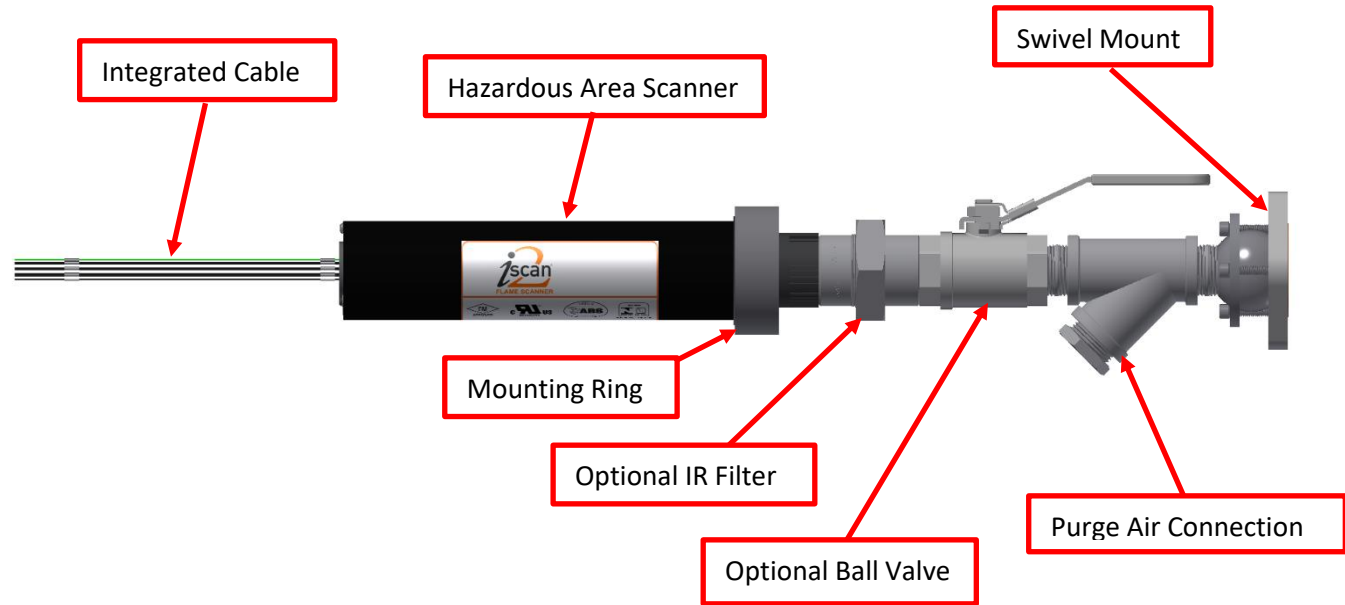

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 21 OF 23

DRAWN BY: AR
ON: 2022-NOV-01

LAST REV BY: ON:

DCO No.
15135

DWG. No. MNL-ISCAN2SB

REV. J

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES

≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)

< 2ft (610 mm) ± 0.125 in (3.2 mm)

MACHINED TOLERANCES

± 0.050 DECIMAL DIM (1 PLACE)

± 0.010 DECIMAL DIM (2 PLACES)

± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.

7 Sighting the Scanner



EXPLOSION HAZARD

Failure to sight the scanner properly can cause an explosion. This Equipment must be installed and serviced by qualified personnel in accordance with applicable local and national codes, standards, and ordinances.

Proper sighting of the flame is required for proper flame scanner detection and discrimination. The view through the sighting port should be full flame, as illustrated below.


CORRECT



INCORRECT



7.1 Flame Line of Sight

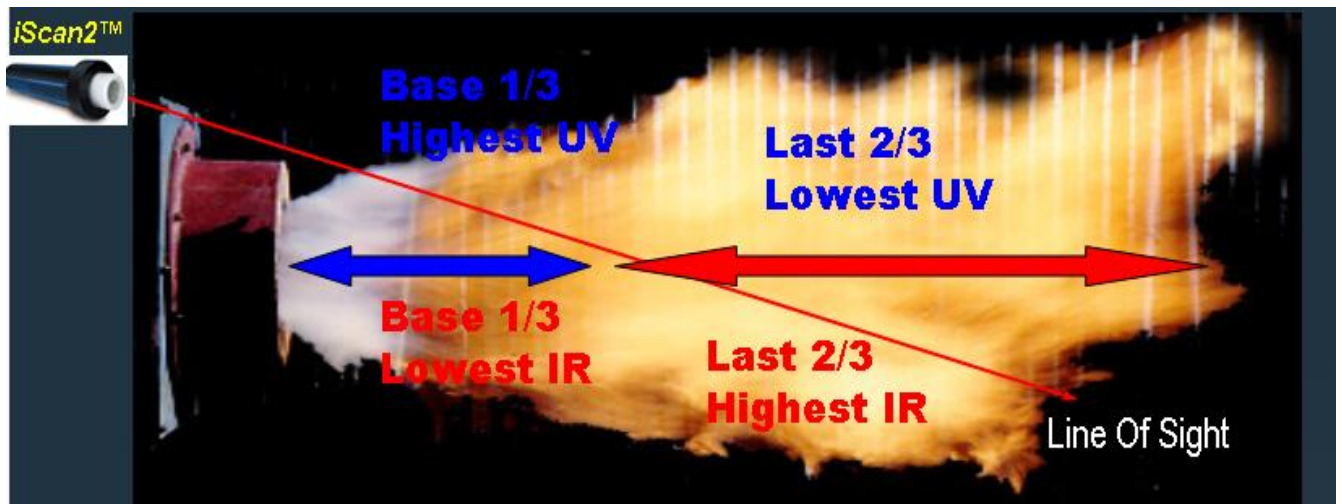

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS
AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 22 OF 23

DRAWN BY:

AR

ON:

2022-NOV-01

LAST REV BY:

ON:

DCO No.

15135

DWG. No.

MNL-ISCAN2SB

REV. J

Chentronics

TOLERANCE NOTES
FABRICATED TOLERANCES
 ≥ 2 ft (610 mm) ± 0.250 in (6.4 mm)
 < 2 ft (610 mm) ± 0.125 in (3.2 mm)
MACHINED TOLERANCES
 ± 0.050 DECIMAL DIM (1 PLACE)
 ± 0.010 DECIMAL DIM (2 PLACES)
 ± 0.005 DECIMAL DIM (3 PLACES)

INSTALLATION & OPERATION MANUAL

THIS DRAWING OWNED BY **CHENTRONICS**. IT IS CONDITIONALLY LOANED AND IS TO BE RETURNED UPON REQUEST. THE BORROWER BY RECEIVING IT HAS AGREED NOT TO REPRODUCE NOR COPY IT IN WHOLE OR IN PART NOR TO FURNISH INFORMATION FROM IT TO OTHERS NOR TO MAKE ANY USE OF IT THAT IS OR MAY BE INJURIOUS TO **CHENTRONICS**. FOR MORE INFORMATION PLEASE CONTACT **CHENTRONICS** AT +1.607.334.5531.


7.2 Sighting Non-hazardous Area Models

Move the scanner while observing the EASI on the back of the scanner. The red LED blinks 1 time per second when no flame is detected. The LED's blink rate increases proportional to the intensity of the flame detection. For optimal sighting, the LED will blink at approximately 30 times per second.



DO NOT use the scanner if the LED is on solid or off.
 If the LED is on solid or off, the scanner is faulted and will not work properly.

Best flame view is indicated when the EASI (LED) is blinking the fastest.

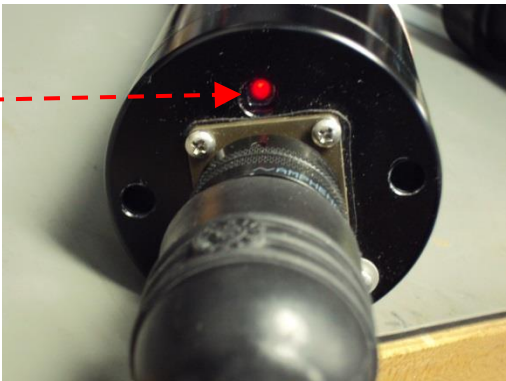

7.3 Sighting Hazardous Area Models

Hazardous area models require measurement of flame strength during the sighting process. Use an ammeter to observe the signal from the 4-20 mA output. This can be observed as current flow between pin 5 to the DC (-) return. Adjust the line of sight to achieve the highest 4-20 mA reading. Ideal aiming provides the highest signal (dB) above the threshold (-45) and the lowest gain value.

8 Maintenance

The scanner is a rugged, high temperature device, and contains no moving parts.



NEVER open the scanner housing. Doing so may damage the scanner and will void the warranty.

RELATED DOCUMENT – MUST COMPLY WITH SCHEDULE DOCUMENT(S):

MNL-ISCANSB

FOR A LIST OF RELEVANT PATENTS
 AND TRADEMARKS PLEASE SEE
CHENTRONICS.COM/LEGAL-NOTICES

ISO 9001 CERTIFIED

INSTALLATION & OPERATION MANUAL

PAGE 23 OF 23

DRAWN BY:
AR

ON:
2022-NOV-01

LAST REV BY:

ON:

DCO No.

15135

DWG. No.

MNL-ISCAN2SB

REV. J

Chentronics